

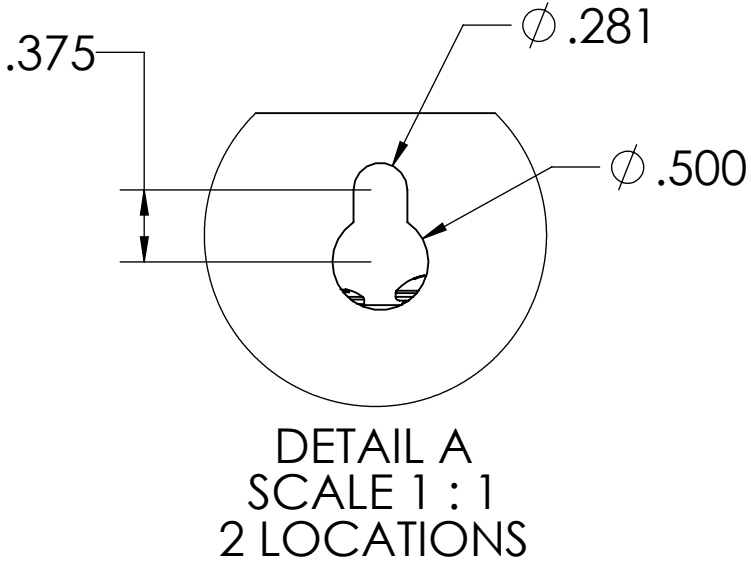
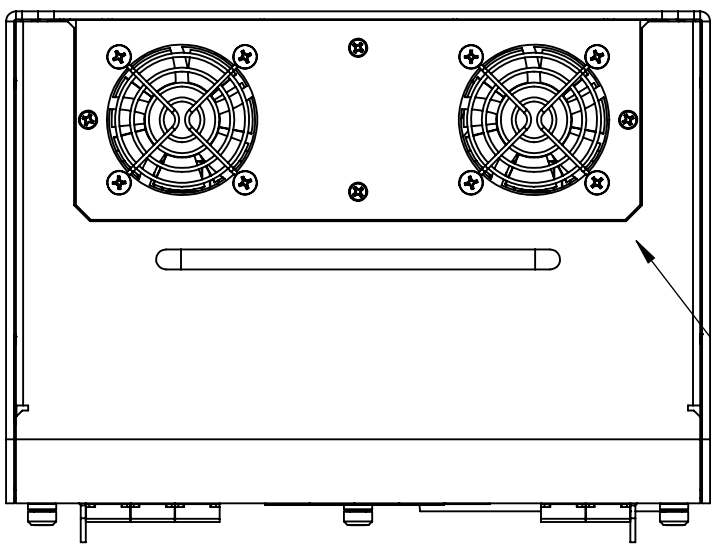
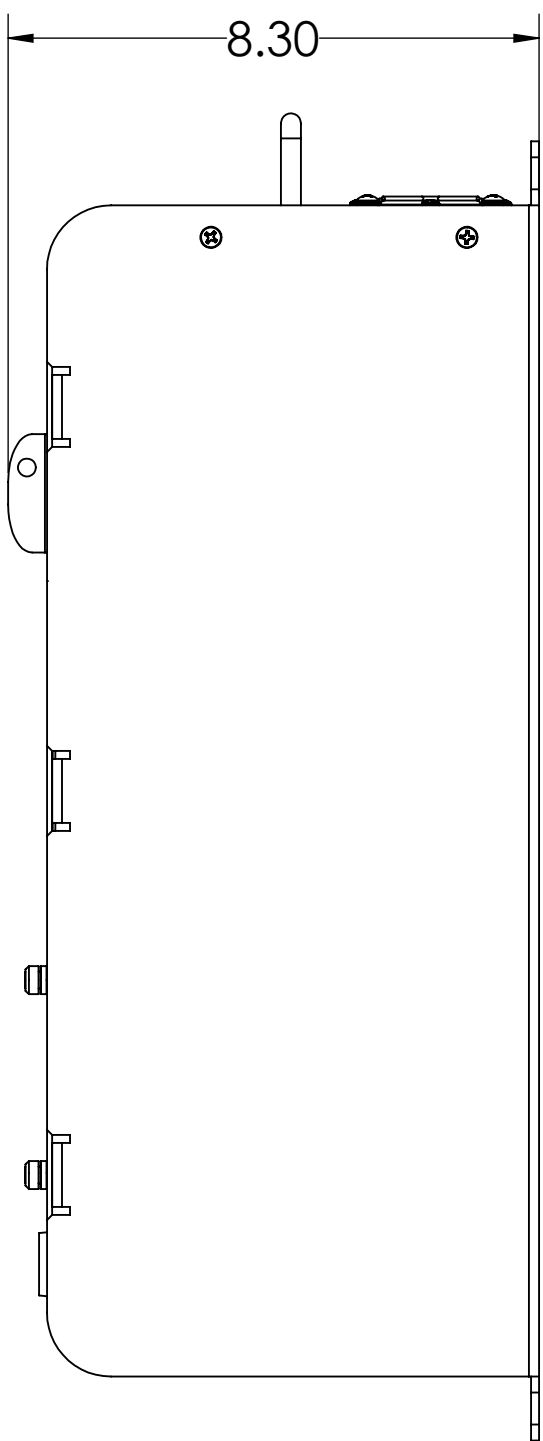


- NOTES:
1. THIS DRAWING IS FOR REFERENCE ONLY.
 2. THE INSTALLATION OF THIS EQUIPMENT SHALL COMPLY WITH ALL LOCAL AUTHORITY AND APPLICABLE BUILDING CODES.
 3. CLEARANCES - FOR VENTILATION AND SERVICABILITY PROVIDE A MINIMUM CLEARANCE OF:
 - 8 INCHES ON TOP OF THE UNIT.
 - 6 INCHES ON BOTTOM OF THE UNIT.
 - 2 INCHES ON EACH SIDE OF THE UNIT.
 4. WEIGHT: 38 LBS MAXIMUM
 5. ***IMPORTANT*** - WHEN INSTALLTING UNIT, ENSURE THAT NO DEBRIS OR PARTICLES FALL INTO UNIT.





REVISIONS				
DCN	REV	DESCRIPTION	DATE	APPROVED
107872	A	INITIAL RELEASE	6/1/2020	ERS

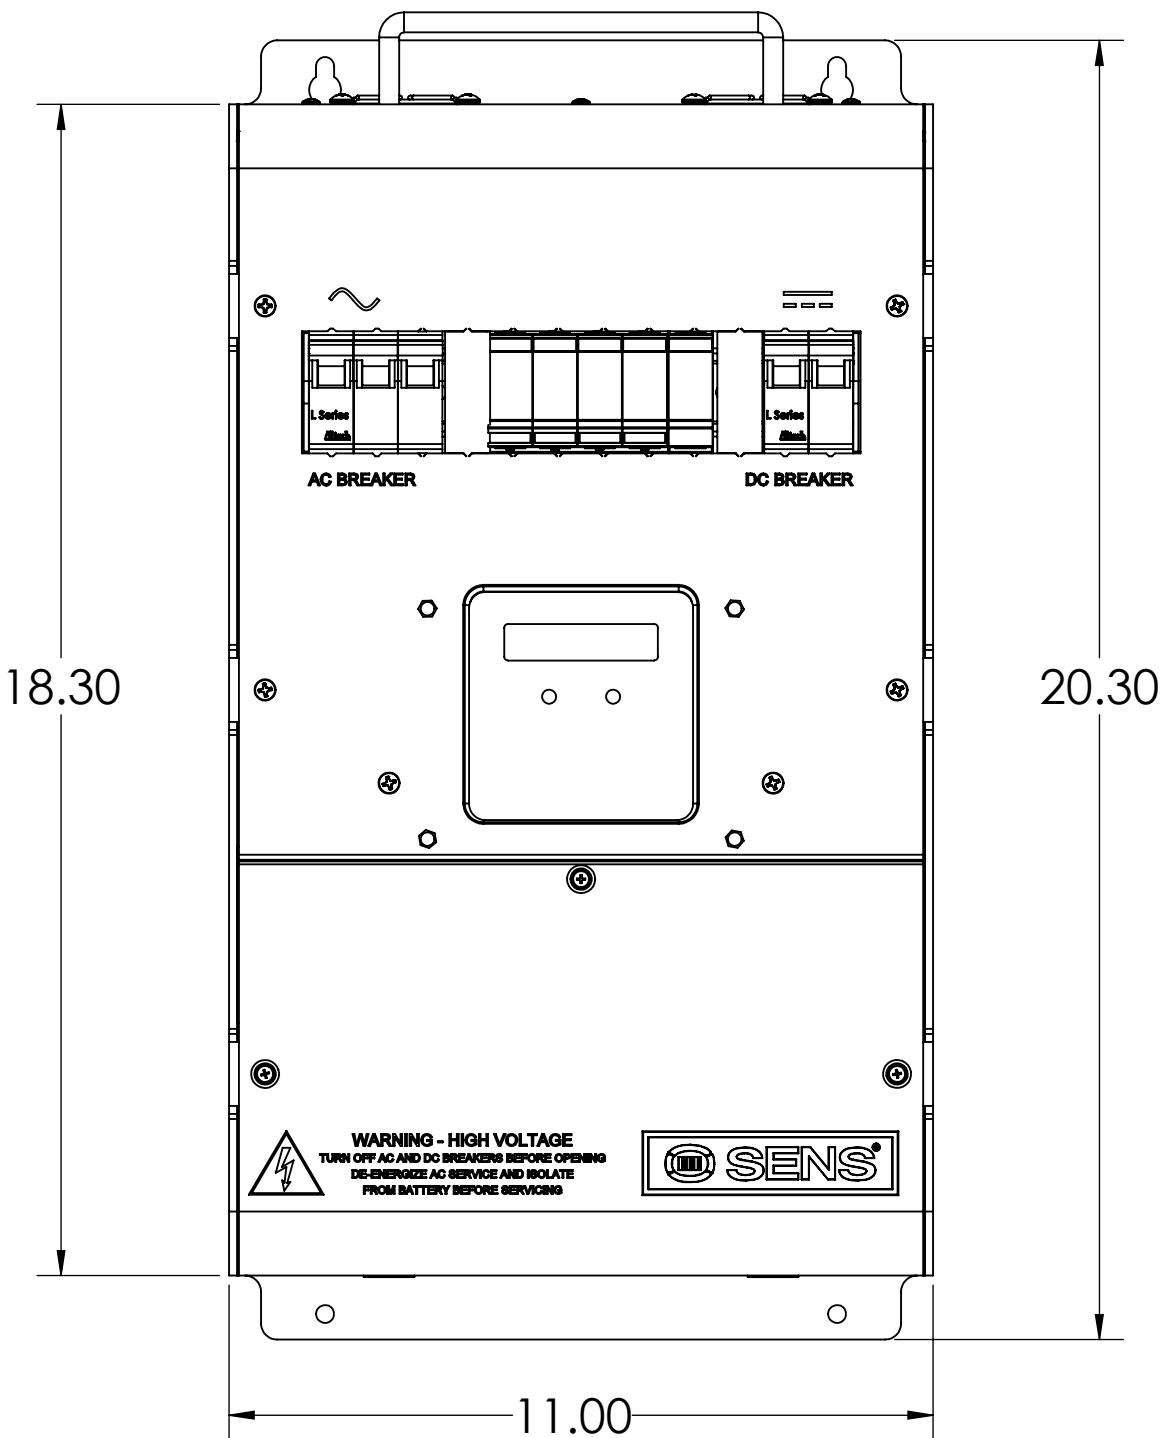

ENSURE NO DEBRIS OR PARTICLES FALL INTO UNIT DURING INSTALLATION

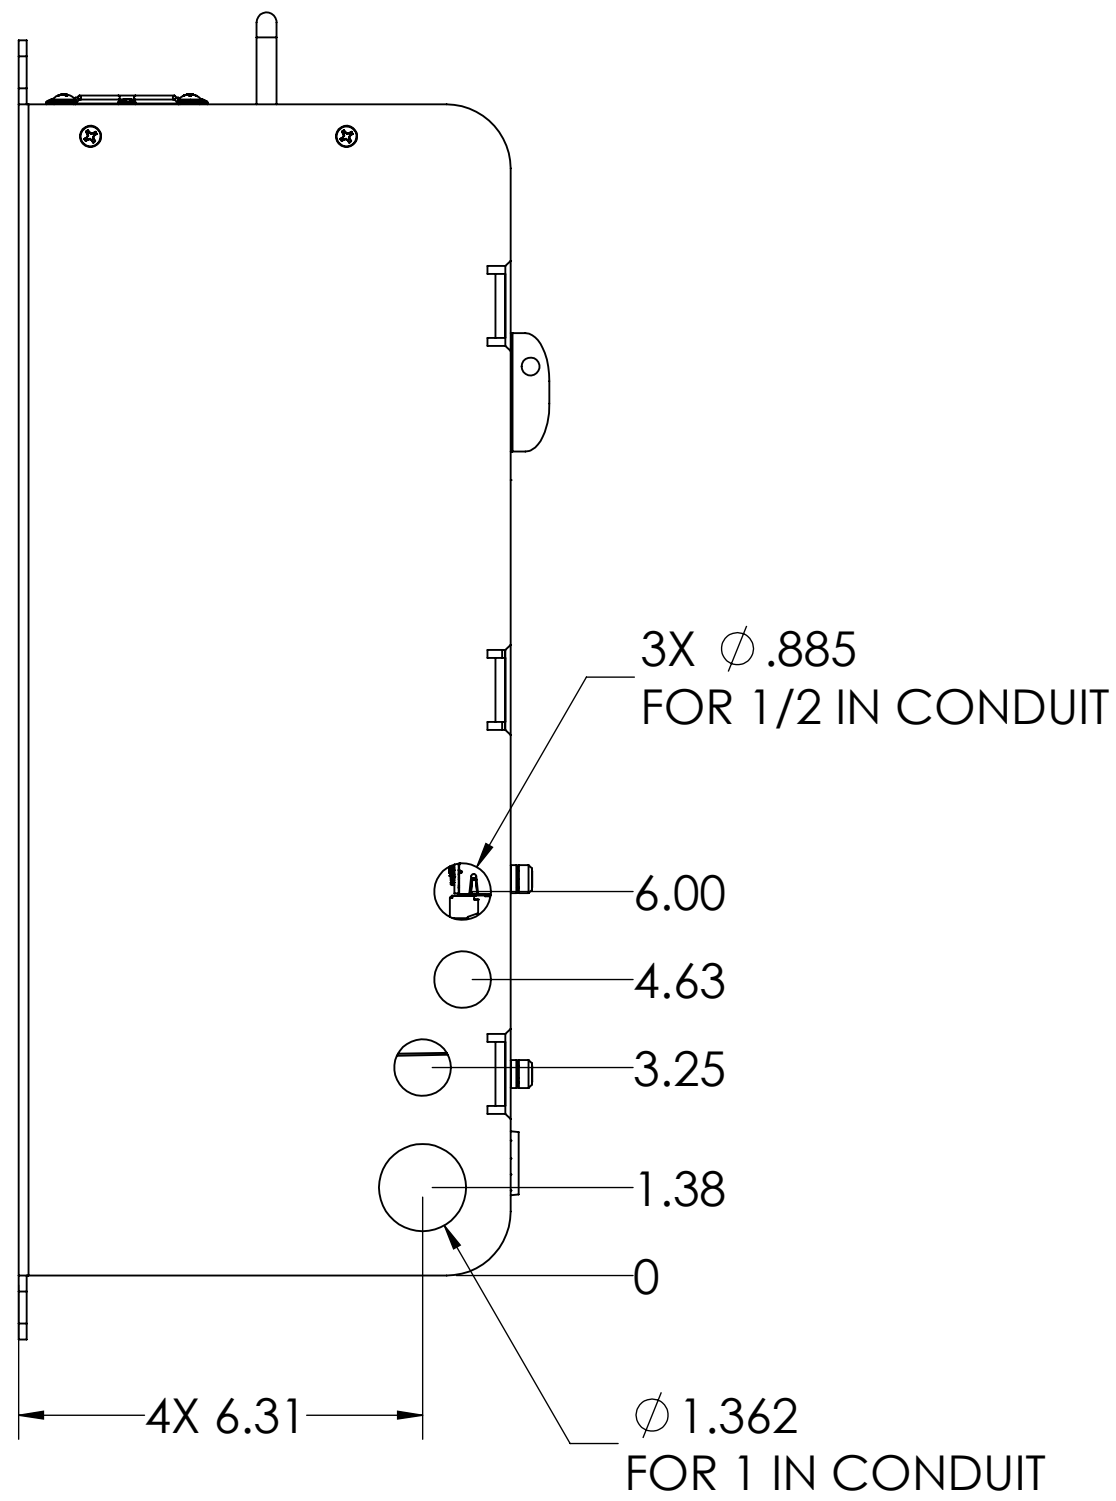

4X MOUNTING LOCATIONS FOR 1/4IN HARDWARE

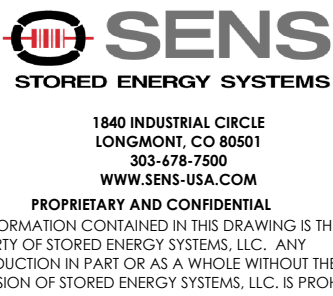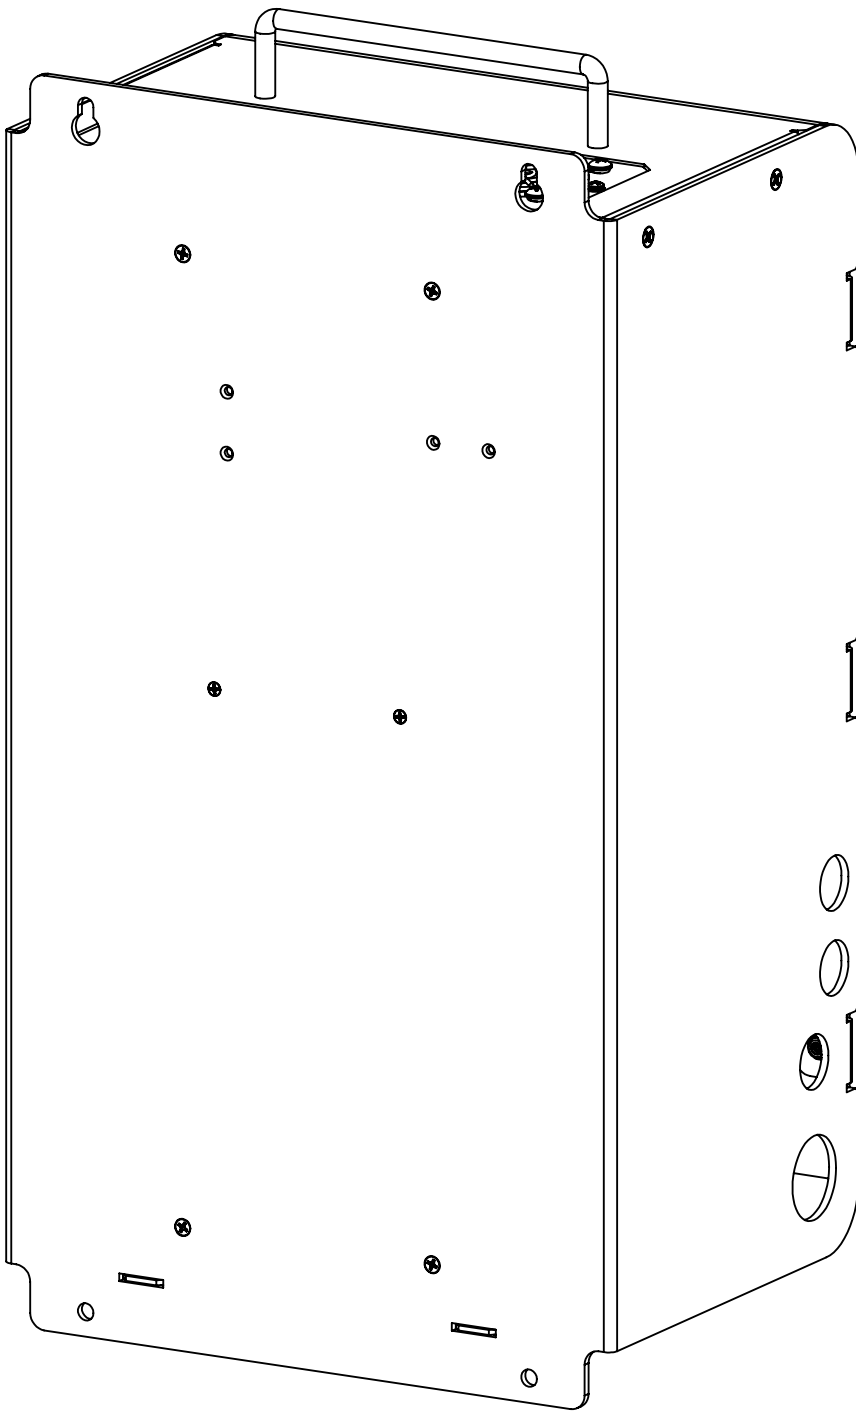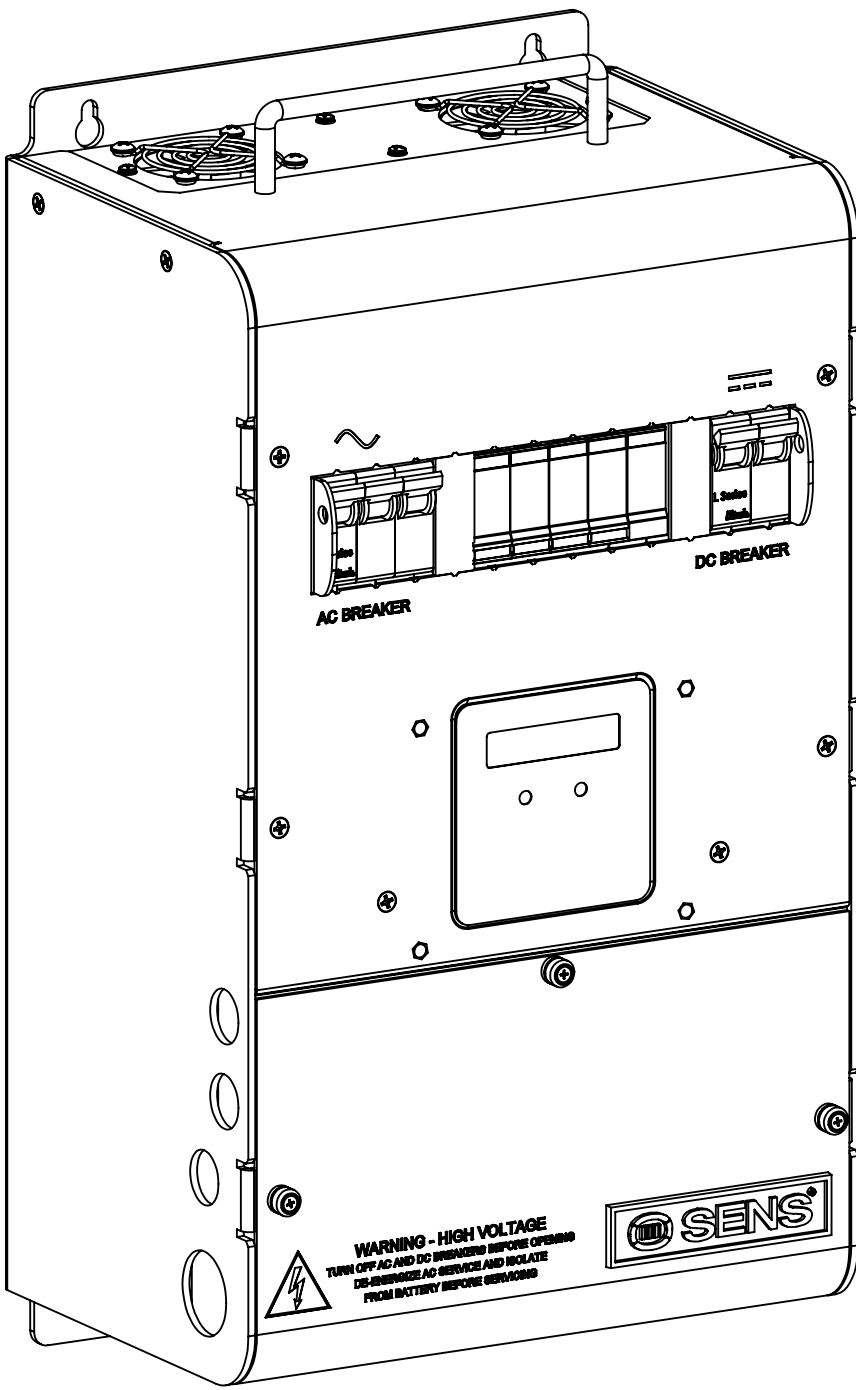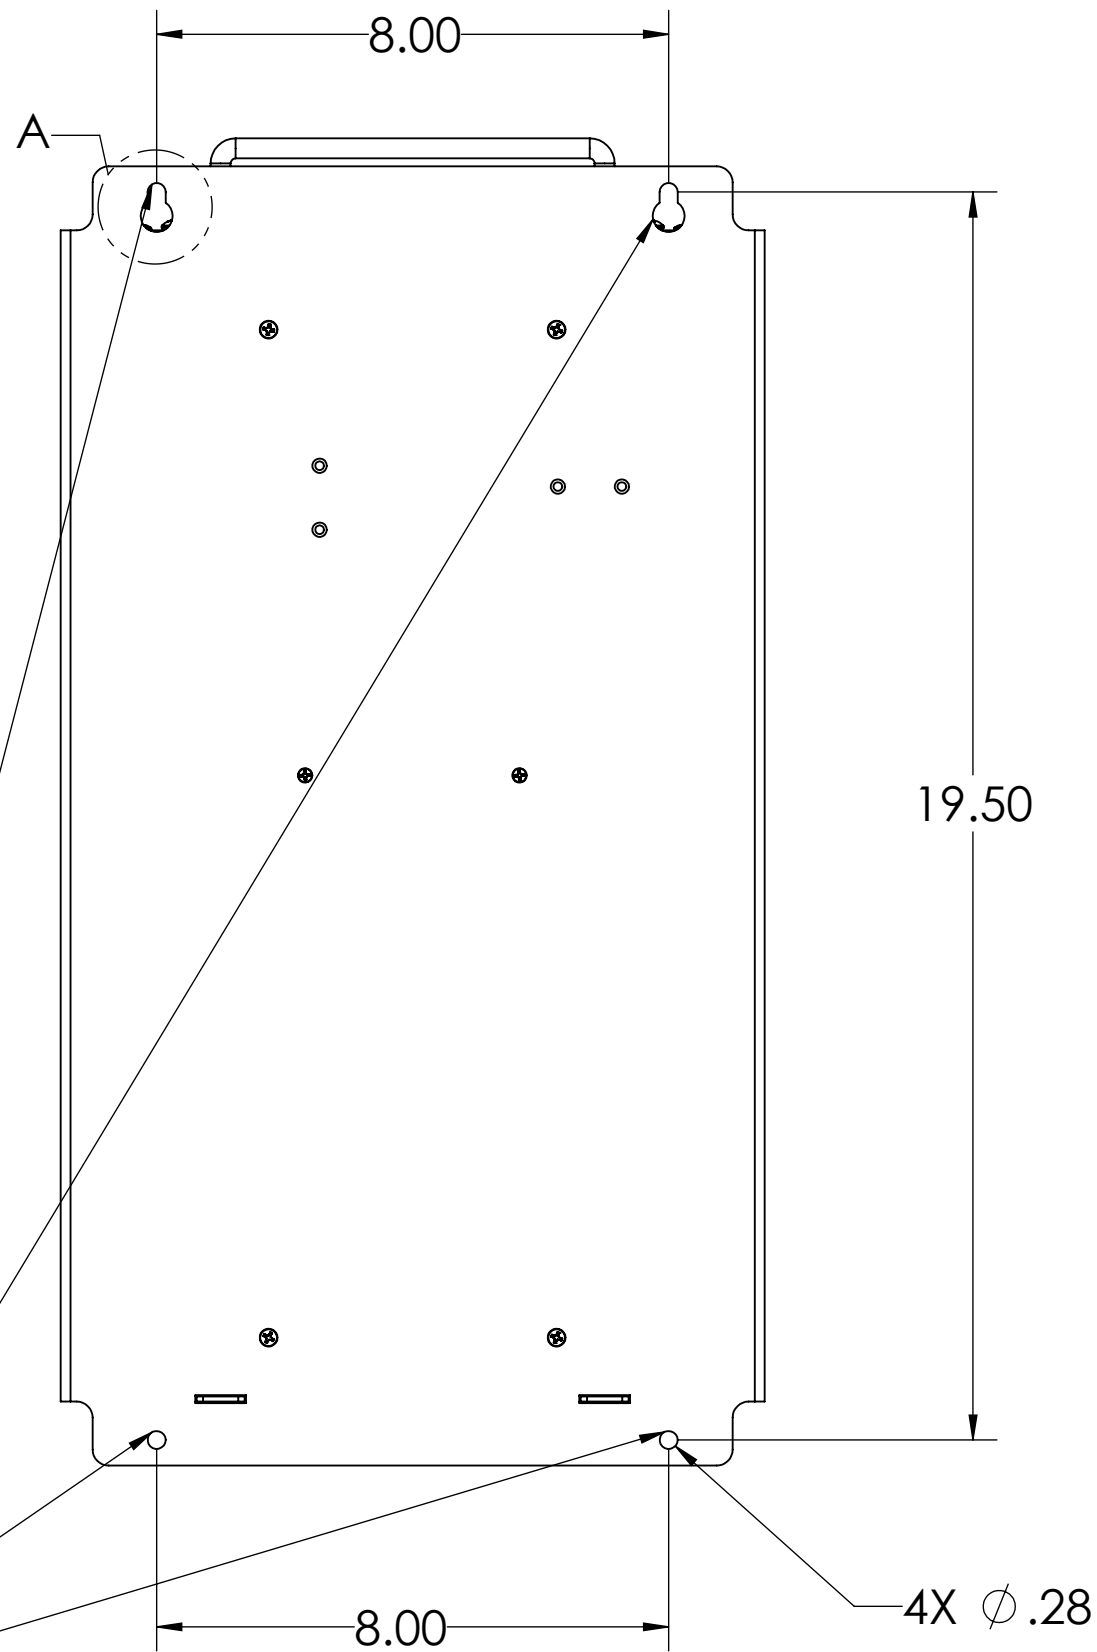

UNLESS OTHERWISE SPECIFIED:
DIMENSIONS ARE IN INCHES
DEFAULT TOLERANCES:
ANGLES ± 1°
TWO PLACE DECIMAL ± .02
THREE PLACE DECIMAL ± .005
DO NOT SCALE DRAWING

NAME	DATE	DESCRIPTION	SIZE	DOCUMENT NUMBER	REV
DRAWN	ERS	6/1/2020		2DCAD,EDC-COMPACT,STANDARD	
CHECKED					
THIRD ANGLE PROJECTION					
DIMENSIONS & TOLERANCES PER ASME Y14.5 - 2007					
			D	2DCAD-EDC-COMPACT-STD	A
			SHEET 1 OF 1		