
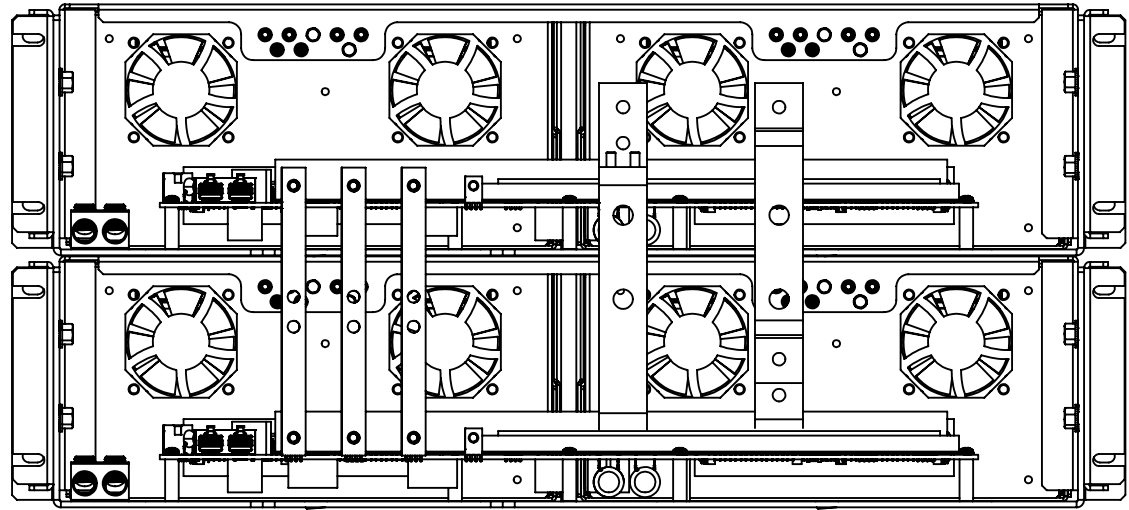
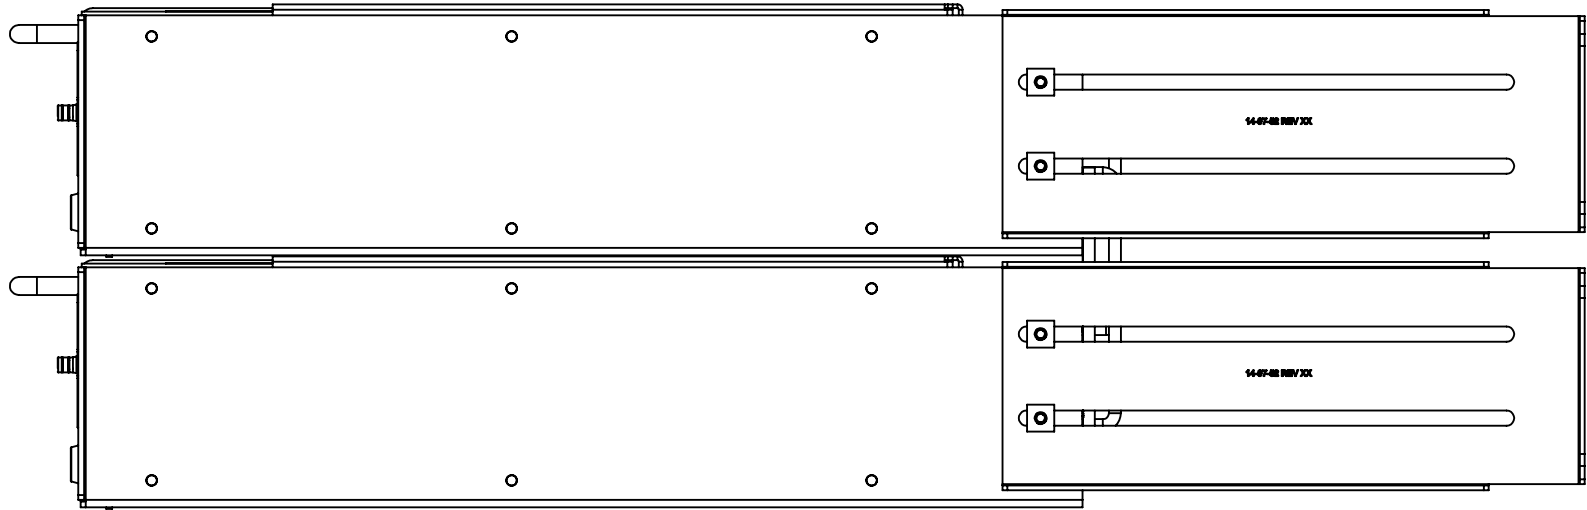
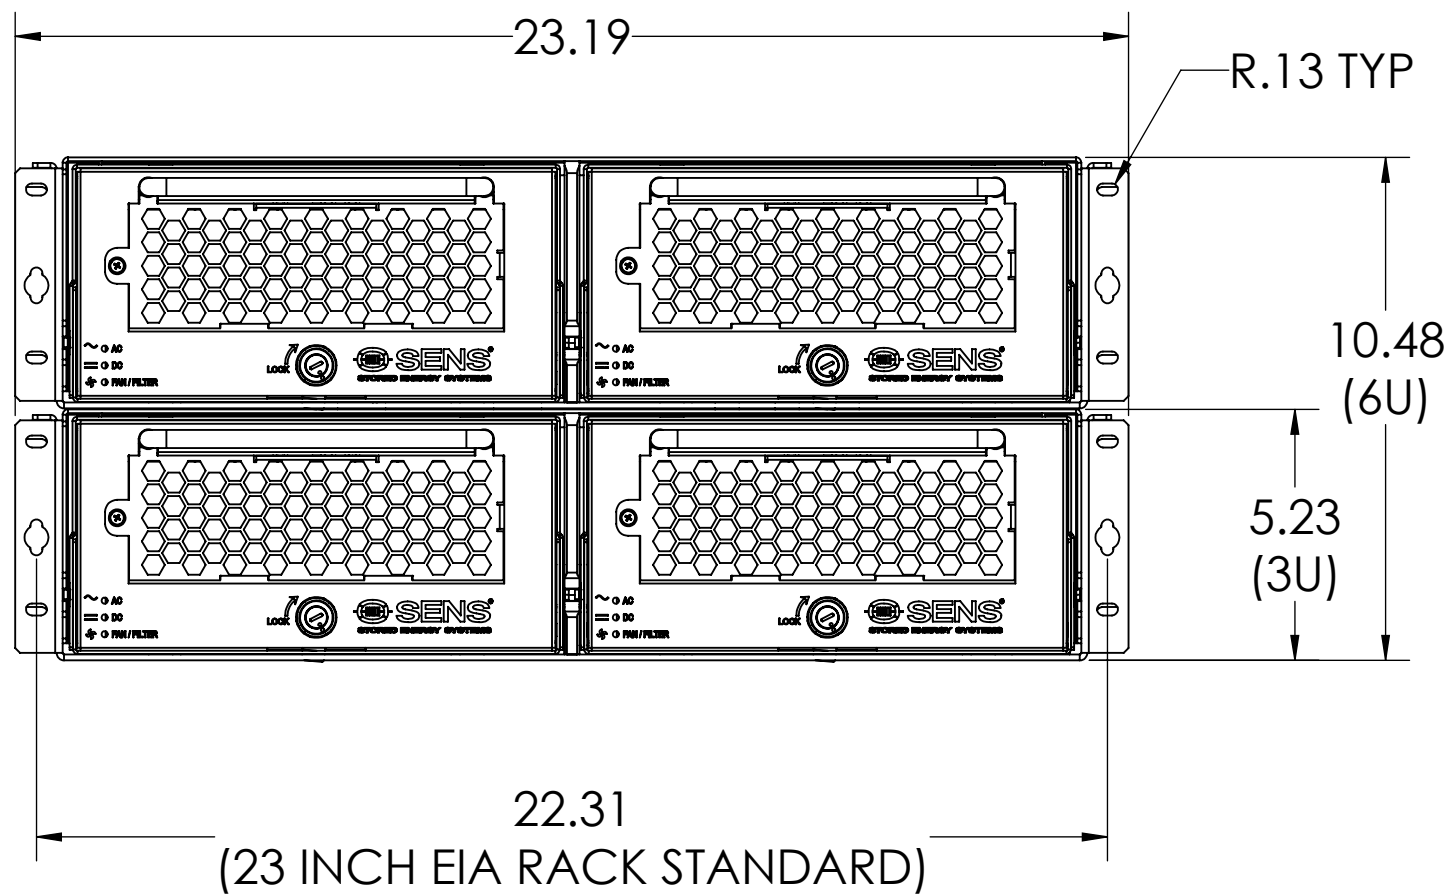
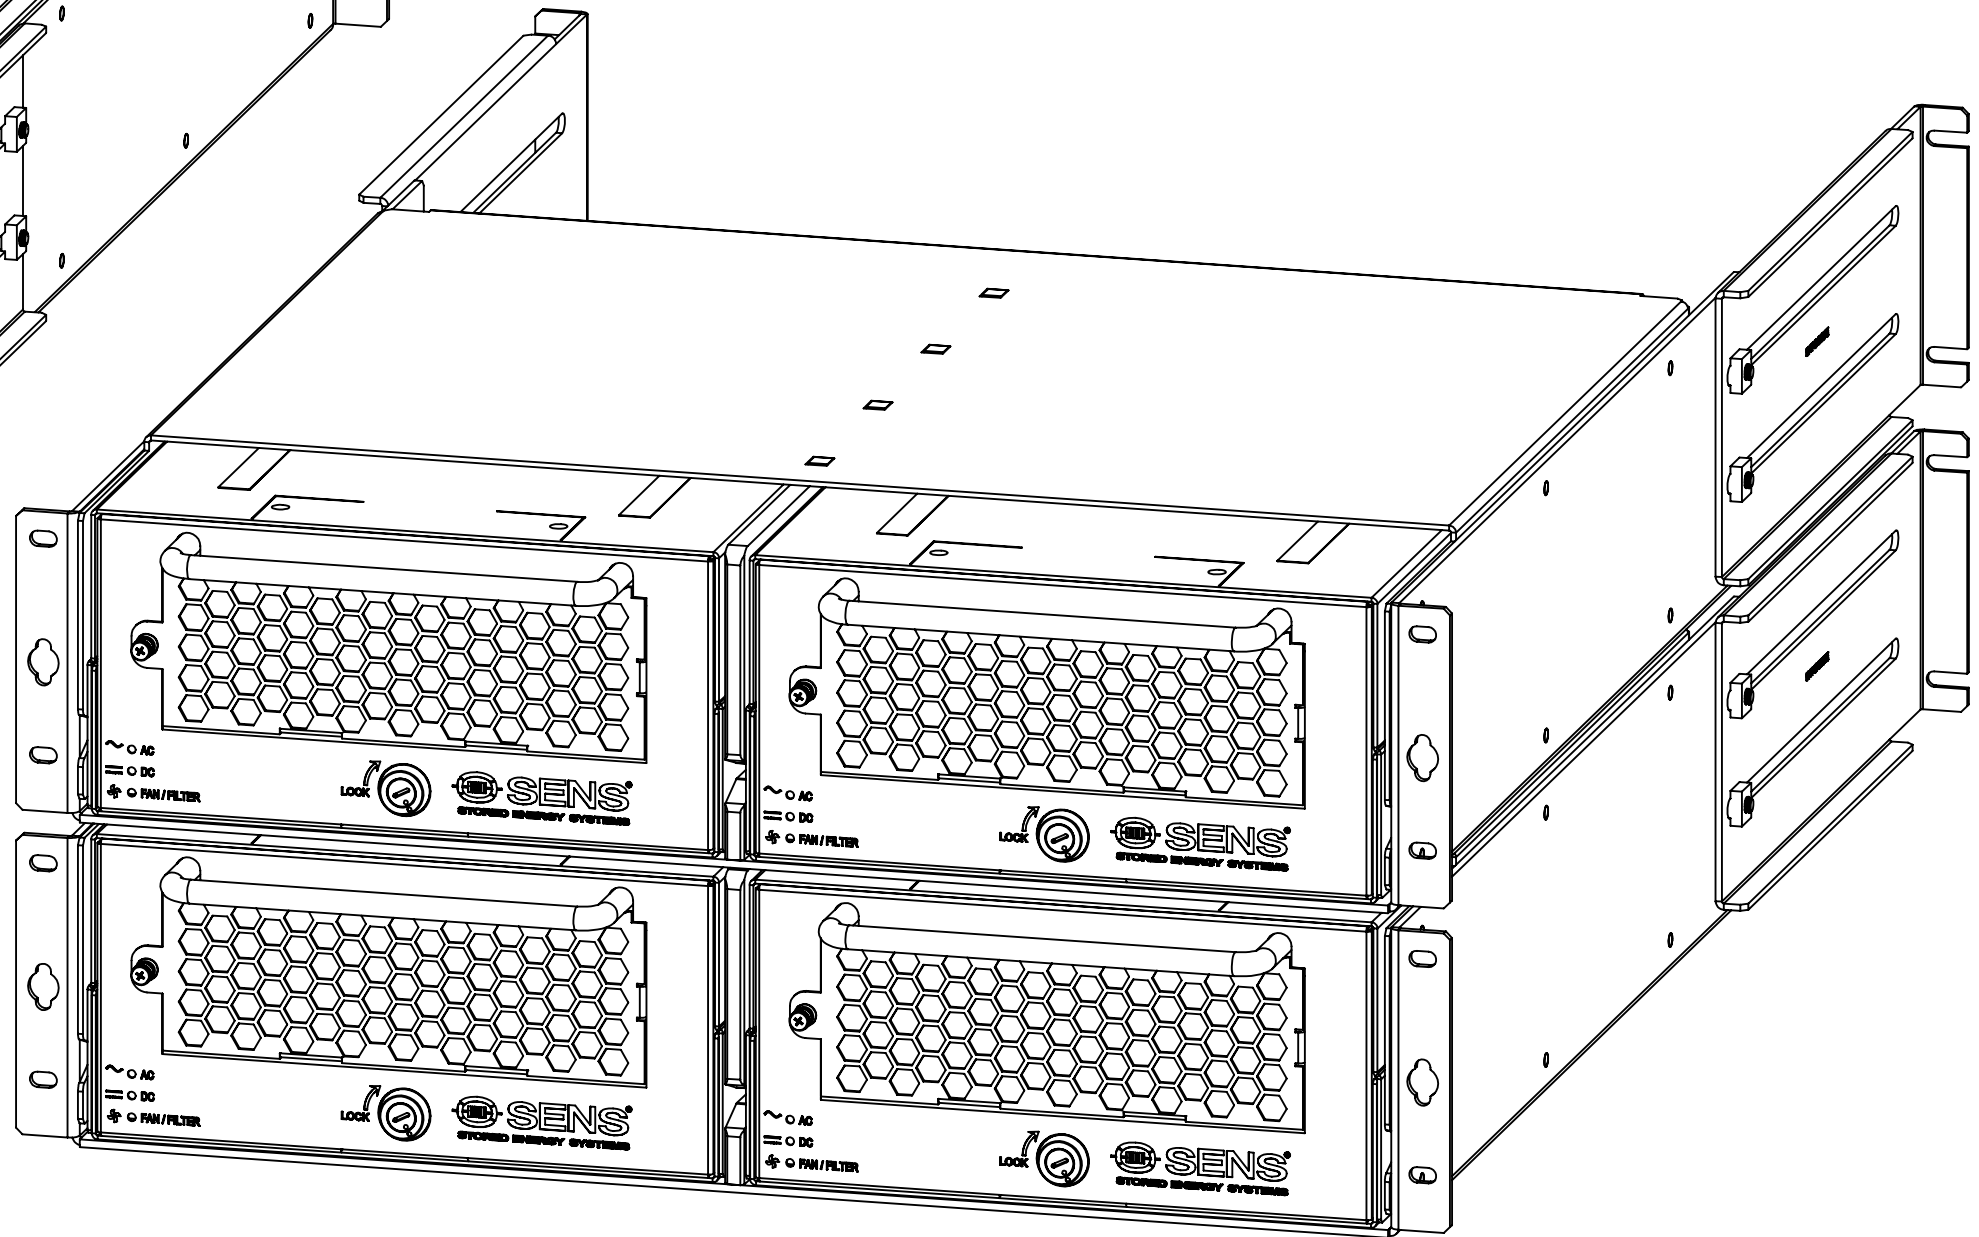
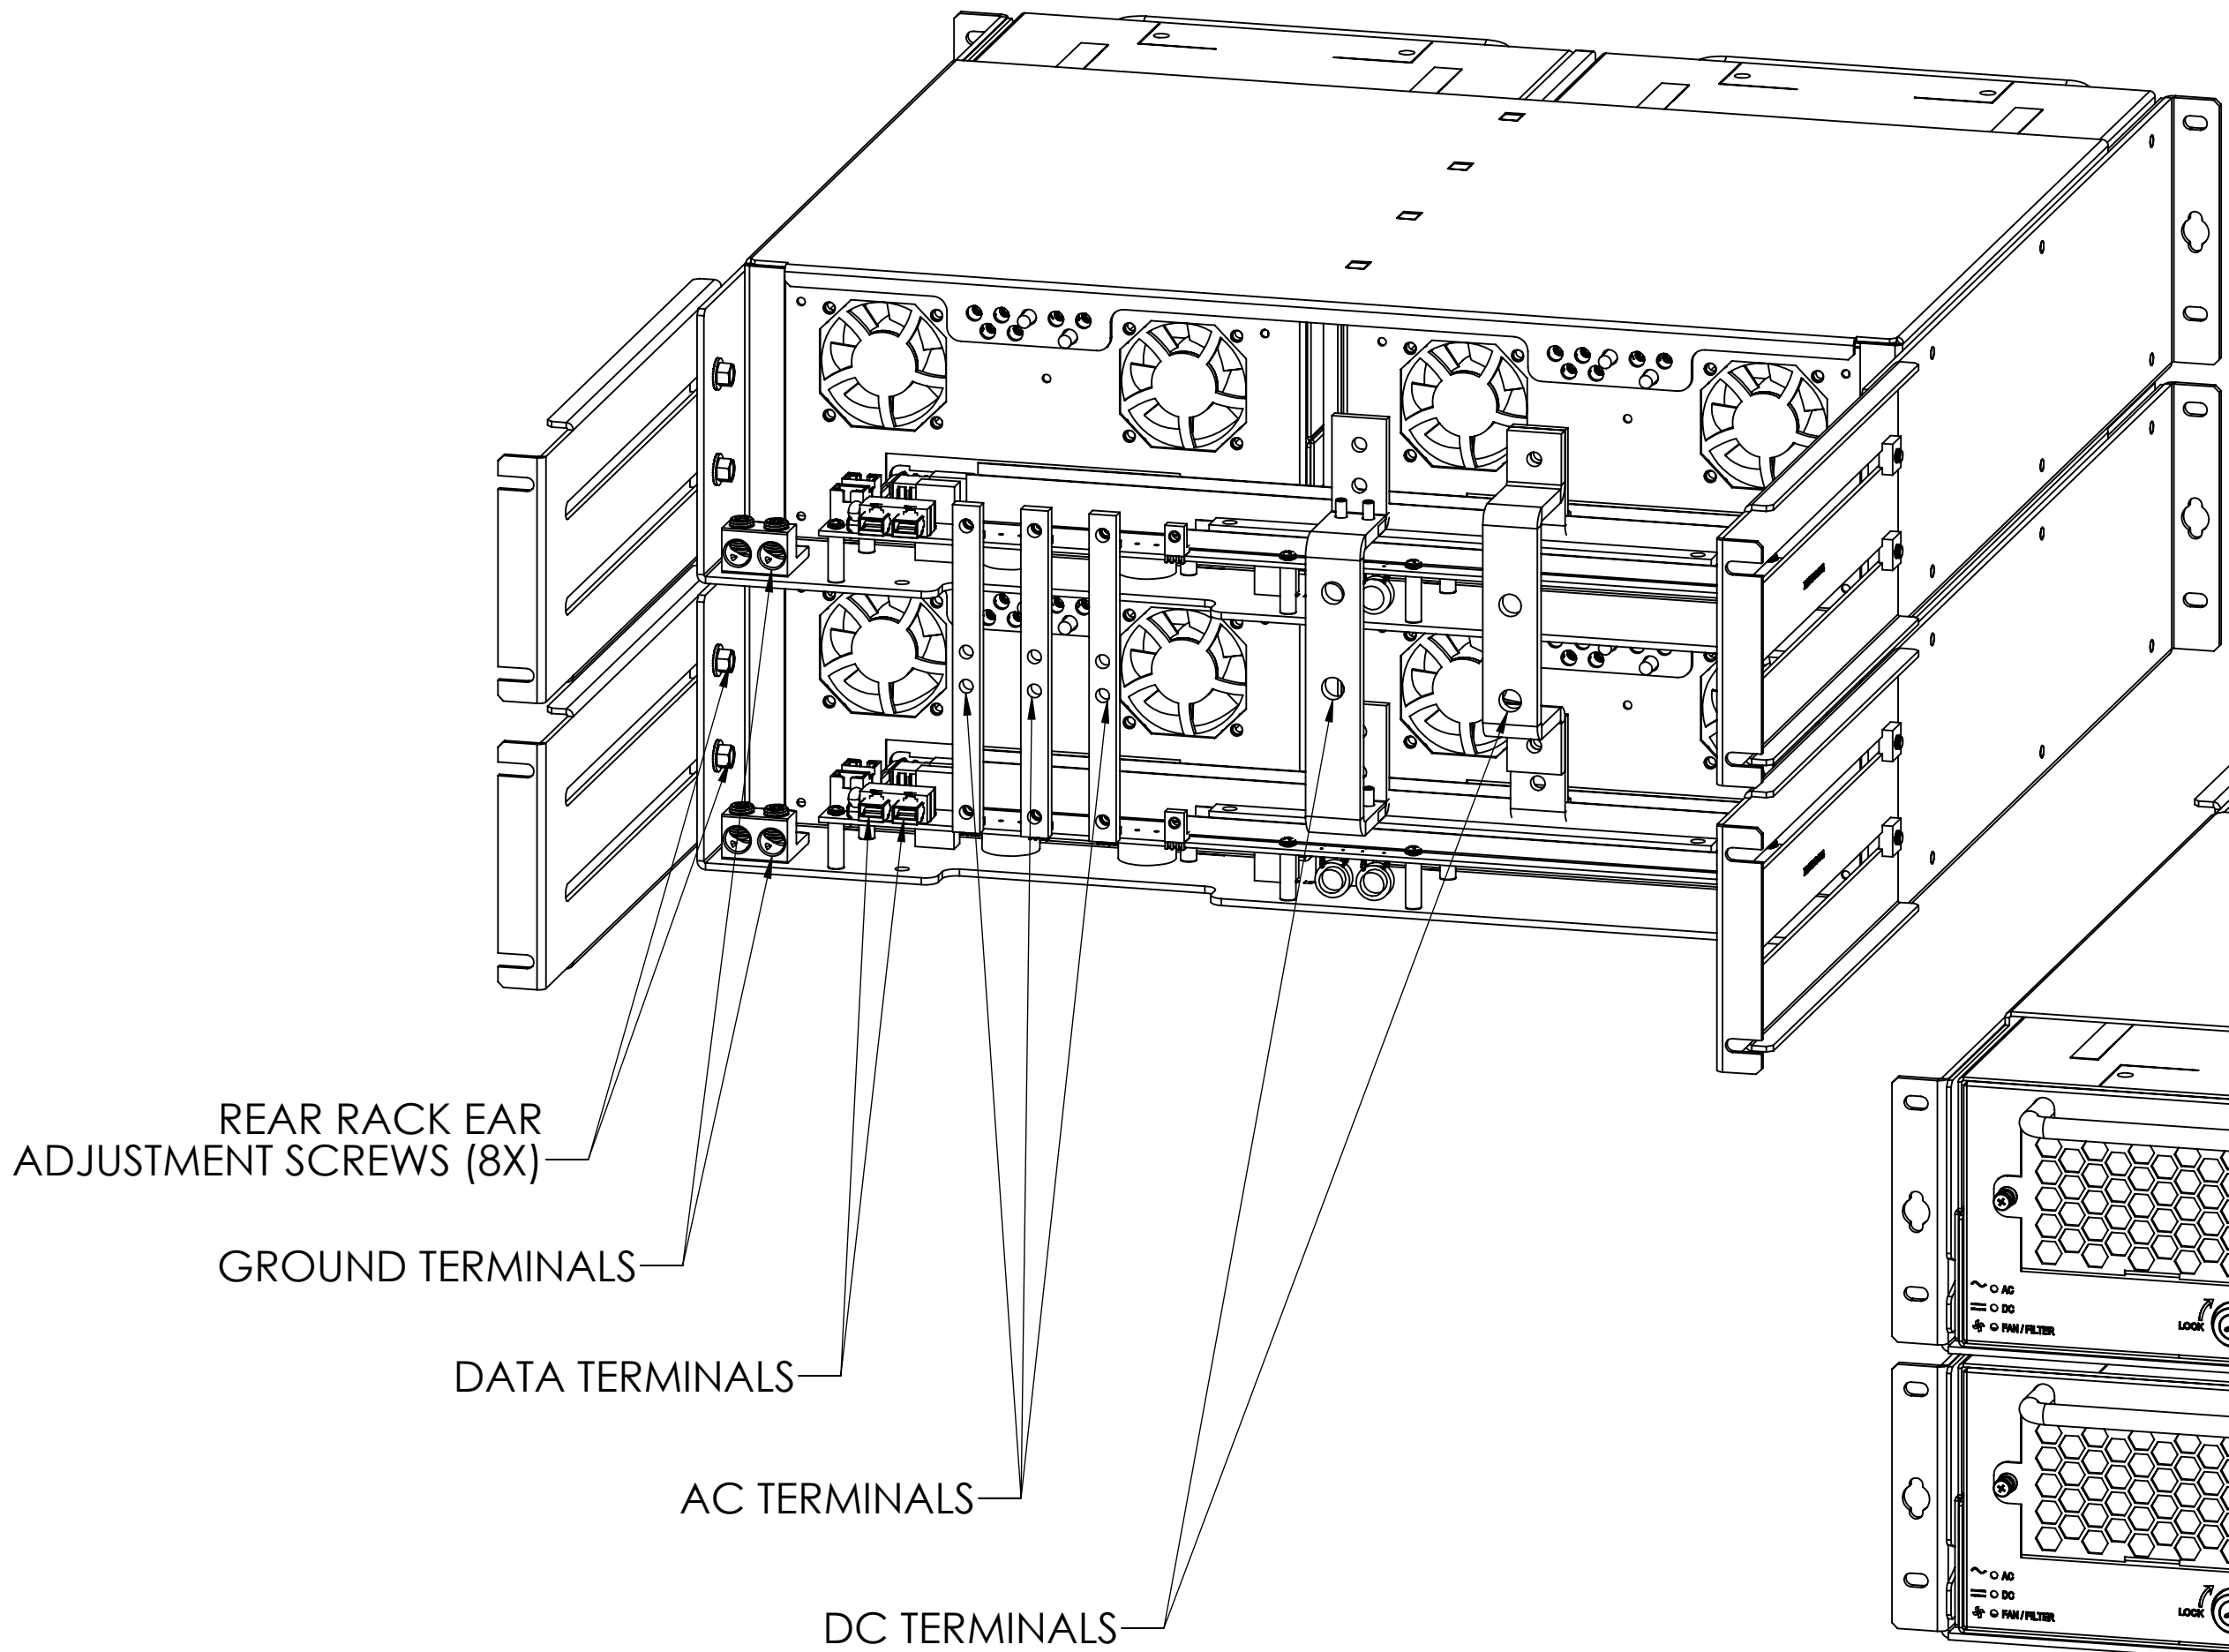


- NOTES:
- THIS DRAWING IS FOR REFERENCE ONLY.
 - THE INSTALLATION OF THIS EQUIPMENT SHALL COMPLY WITH ALL LOCAL AUTHORITY AND APPLICABLE BUILDING CODES.
 - CLEARANCES - FOR VENTILATION AND SERVICABILITY PROVIDE A MINIMUM CLEARANCE OF:
 - 2 INCHES ON FRONT OF THE UNIT.
 - 2 INCHES ON BACK OF THE UNIT.
 - WEIGHT: 118 LBS MAXIMUM

REVISIONS				
DCN	REV	DESCRIPTION	DATE	APPROVED
107872	A	INITIAL RELEASE	6/1/2020	ERS

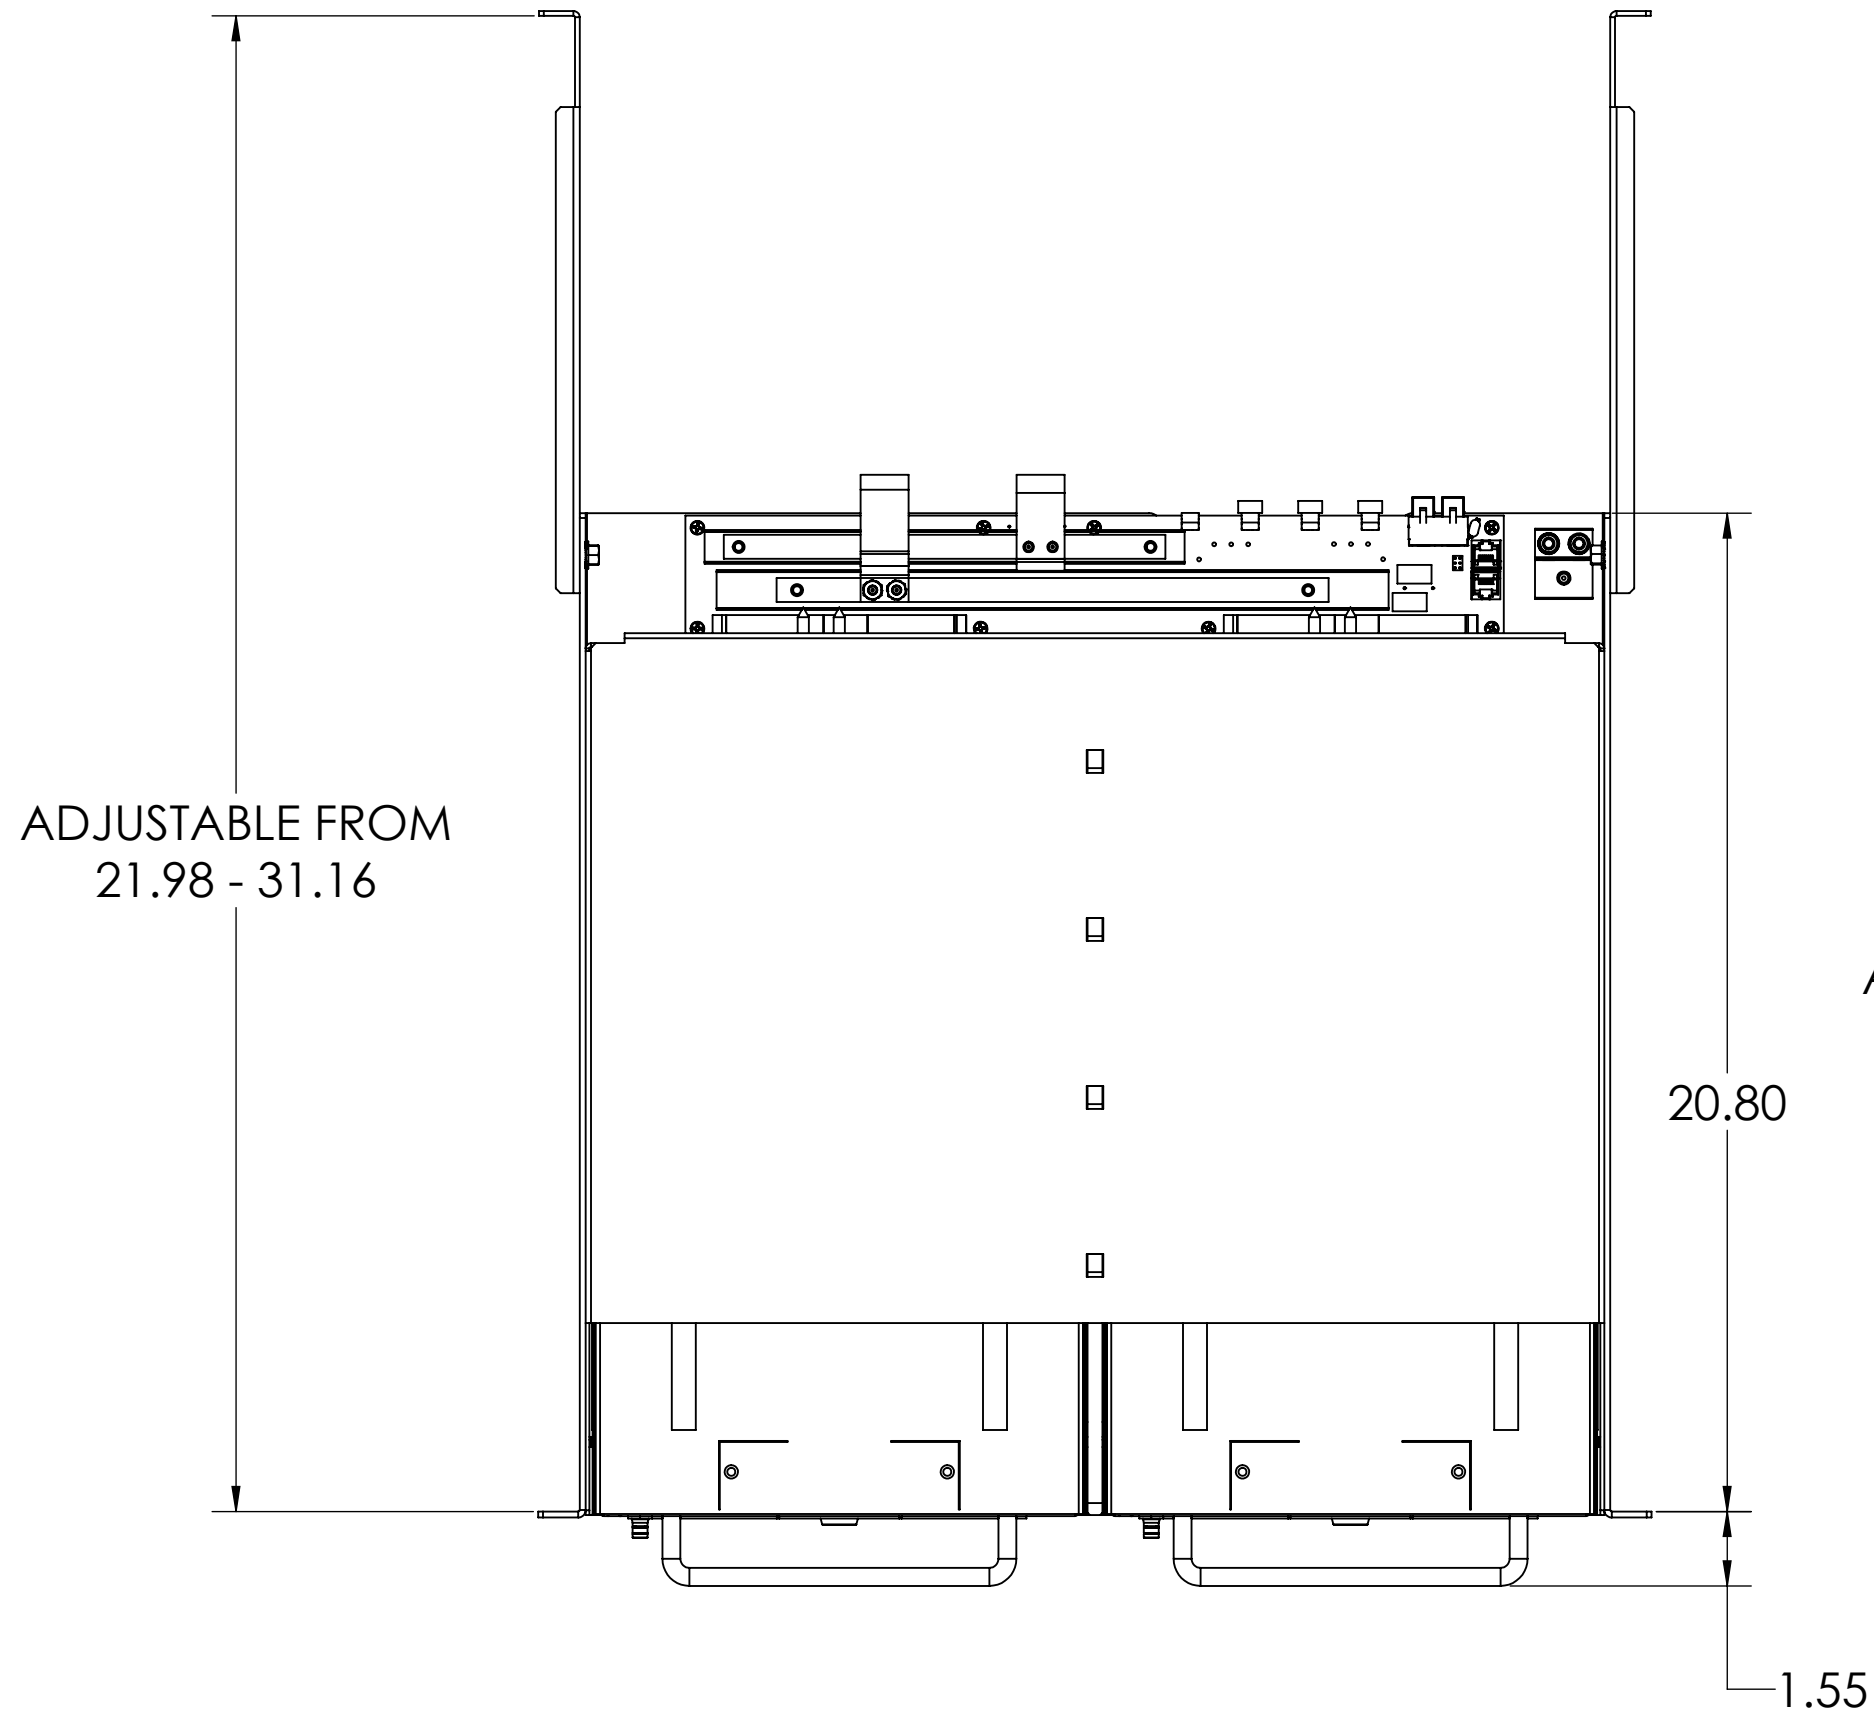

UNLESS OTHERWISE SPECIFIED:
DIMENSIONS ARE IN INCHES
DEFAULT TOLERANCES:
ANGLES $\pm 1^\circ$
TWO PLACE DECIMAL $\pm .02$
THREE PLACE DECIMAL $\pm .005$
DO NOT SCALE DRAWING

NAME	DATE	DESCRIPTION		
DRAWN ERS	6/1/2020	2DCAD,EDC-DOUBLE SHELF,STANDARD		
CHECKED				
THIRD ANGLE PROJECTION		SIZE	DOCUMENT NUMBER	REV
		D	2DCAD-EDC-DOUBLE_SHELF-STD	A
DIMENSIONS & TOLERANCES PER ASME Y14.5 - 2009		SHEET 1 OF 1		