
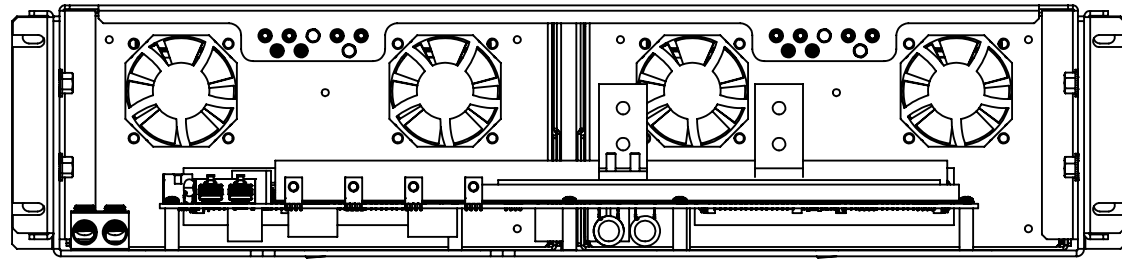
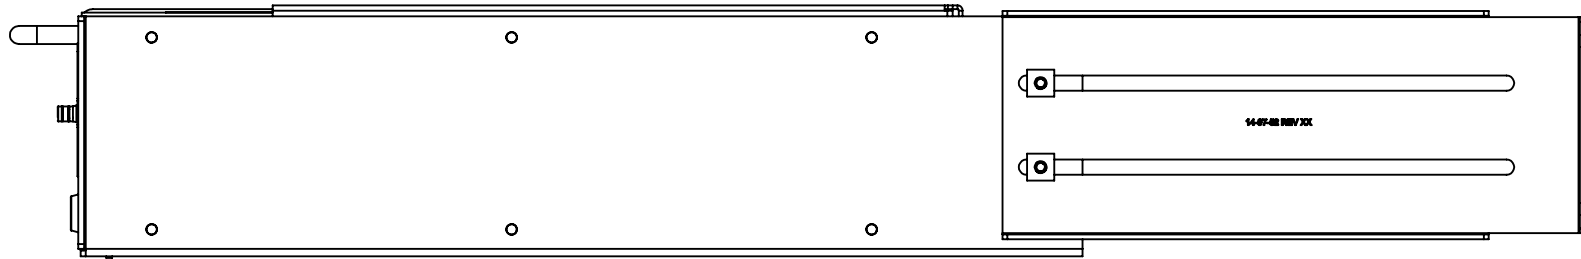
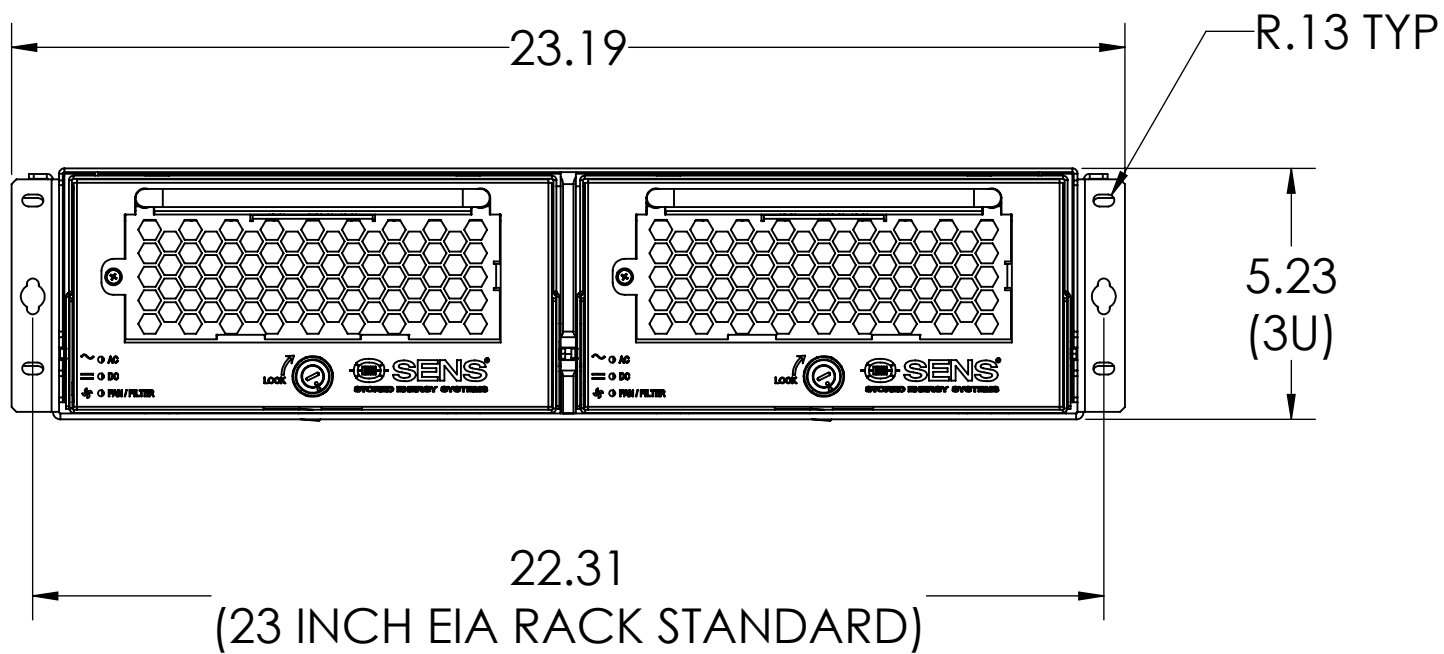
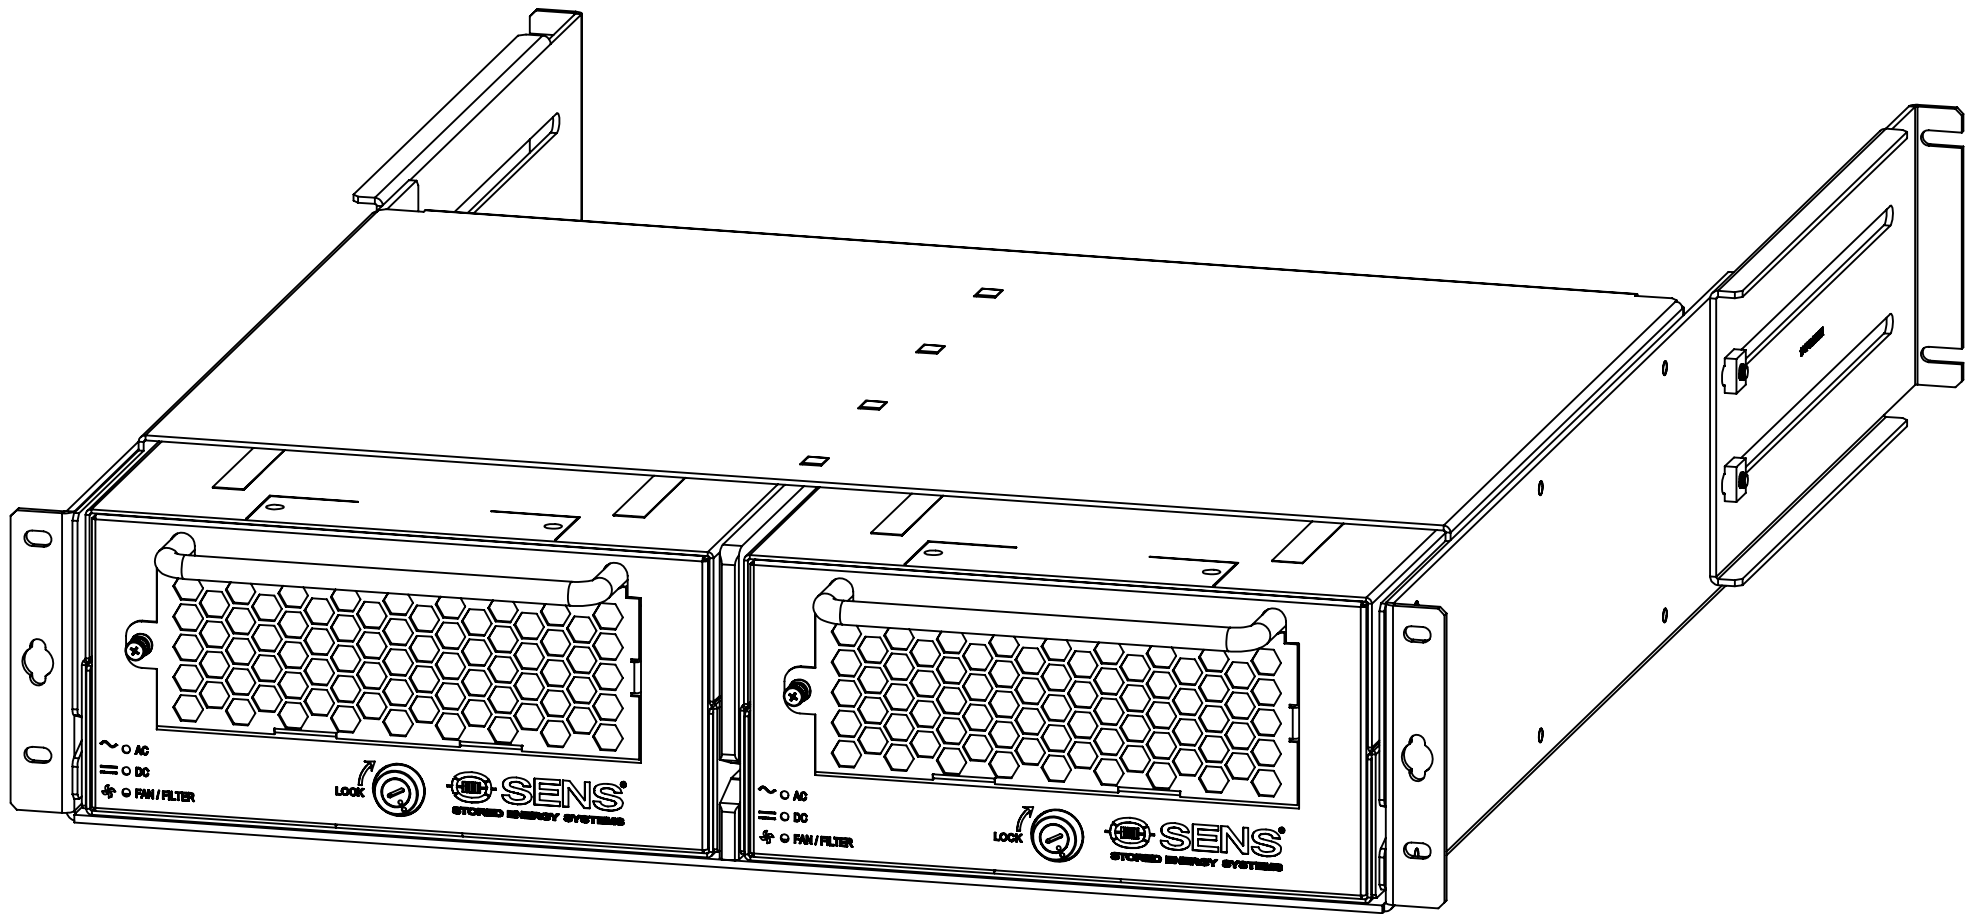
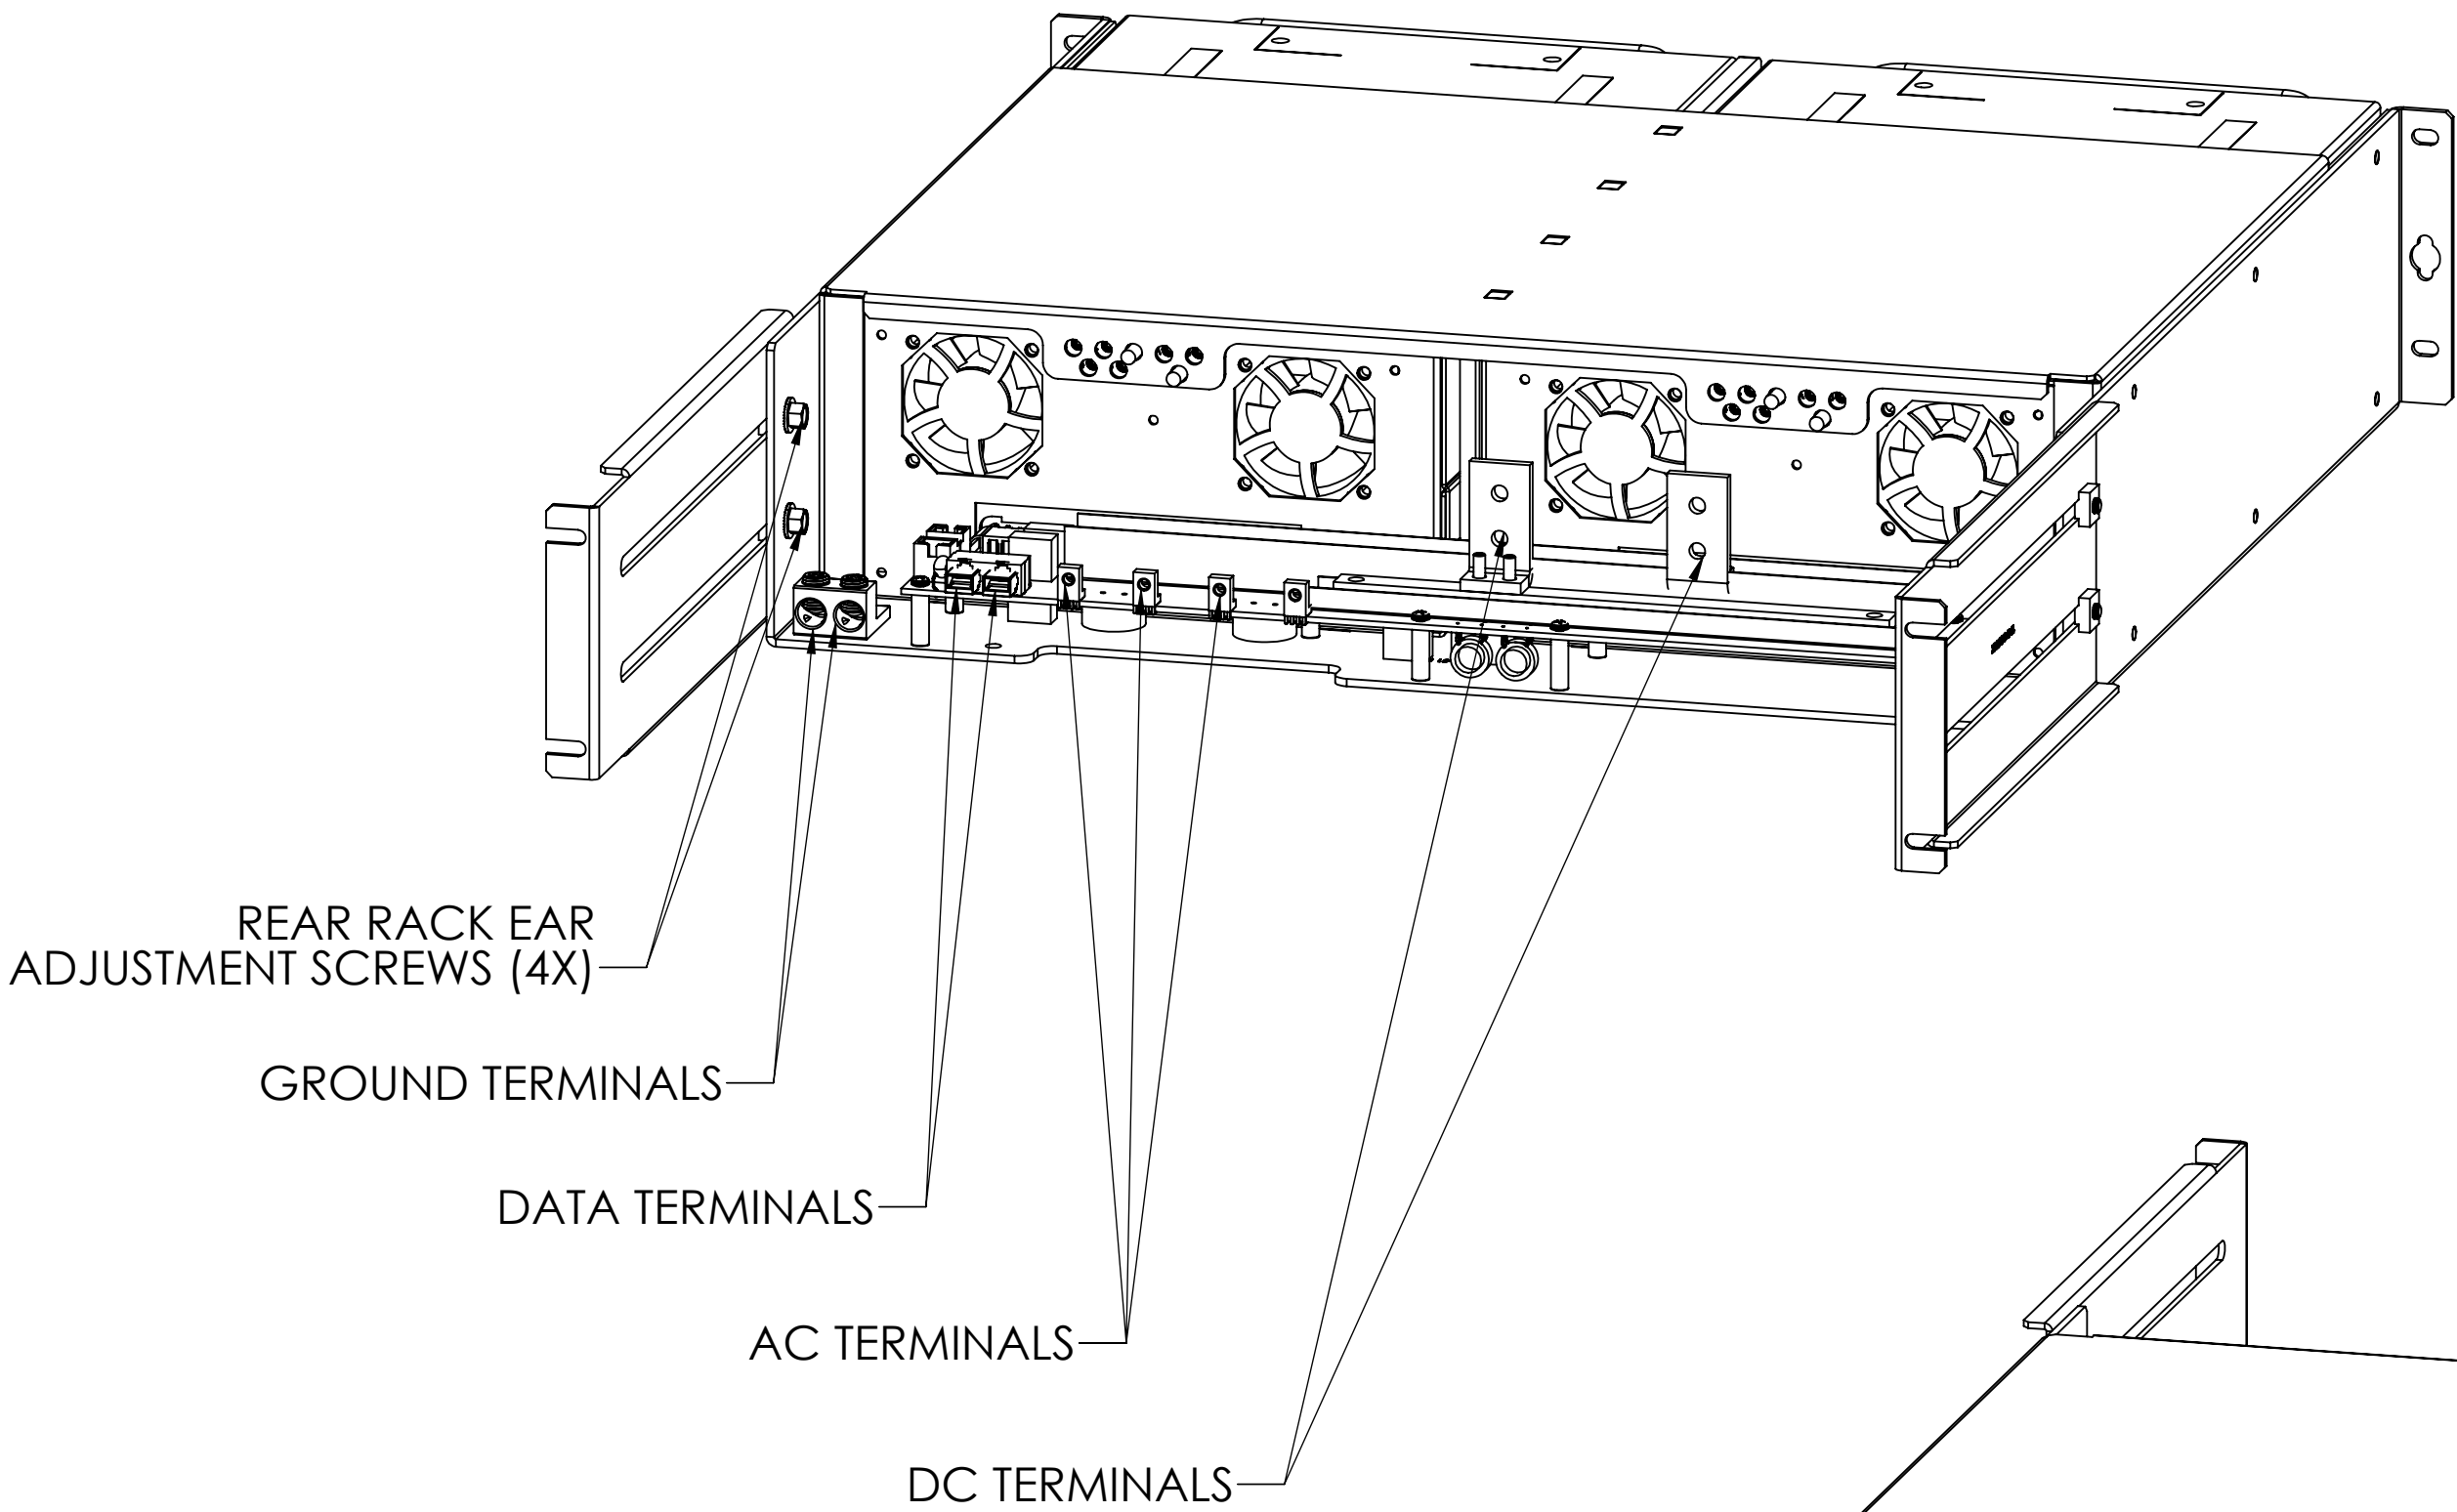


- NOTES:
1. THIS DRAWING IS FOR REFERENCE ONLY.
 2. THE INSTALLATION OF THIS EQUIPMENT SHALL COMPLY WITH ALL LOCAL AUTHORITY AND APPLICABLE BUILDING CODES.
 3. CLEARANCES - FOR VENTILATION AND SERVICABILITY PROVIDE A MINIMUM CLEARANCE OF:
 - 2 INCHES ON FRONT OF THE UNIT.
 - 2 INCHES ON BACK OF THE UNIT.
 4. WEIGHT: 56 LBS MAXIMUM

REVISIONS				
DCN	REV	DESCRIPTION	DATE	APPROVED
107872	A	INITIAL RELEASE	6/1/2020	ERS

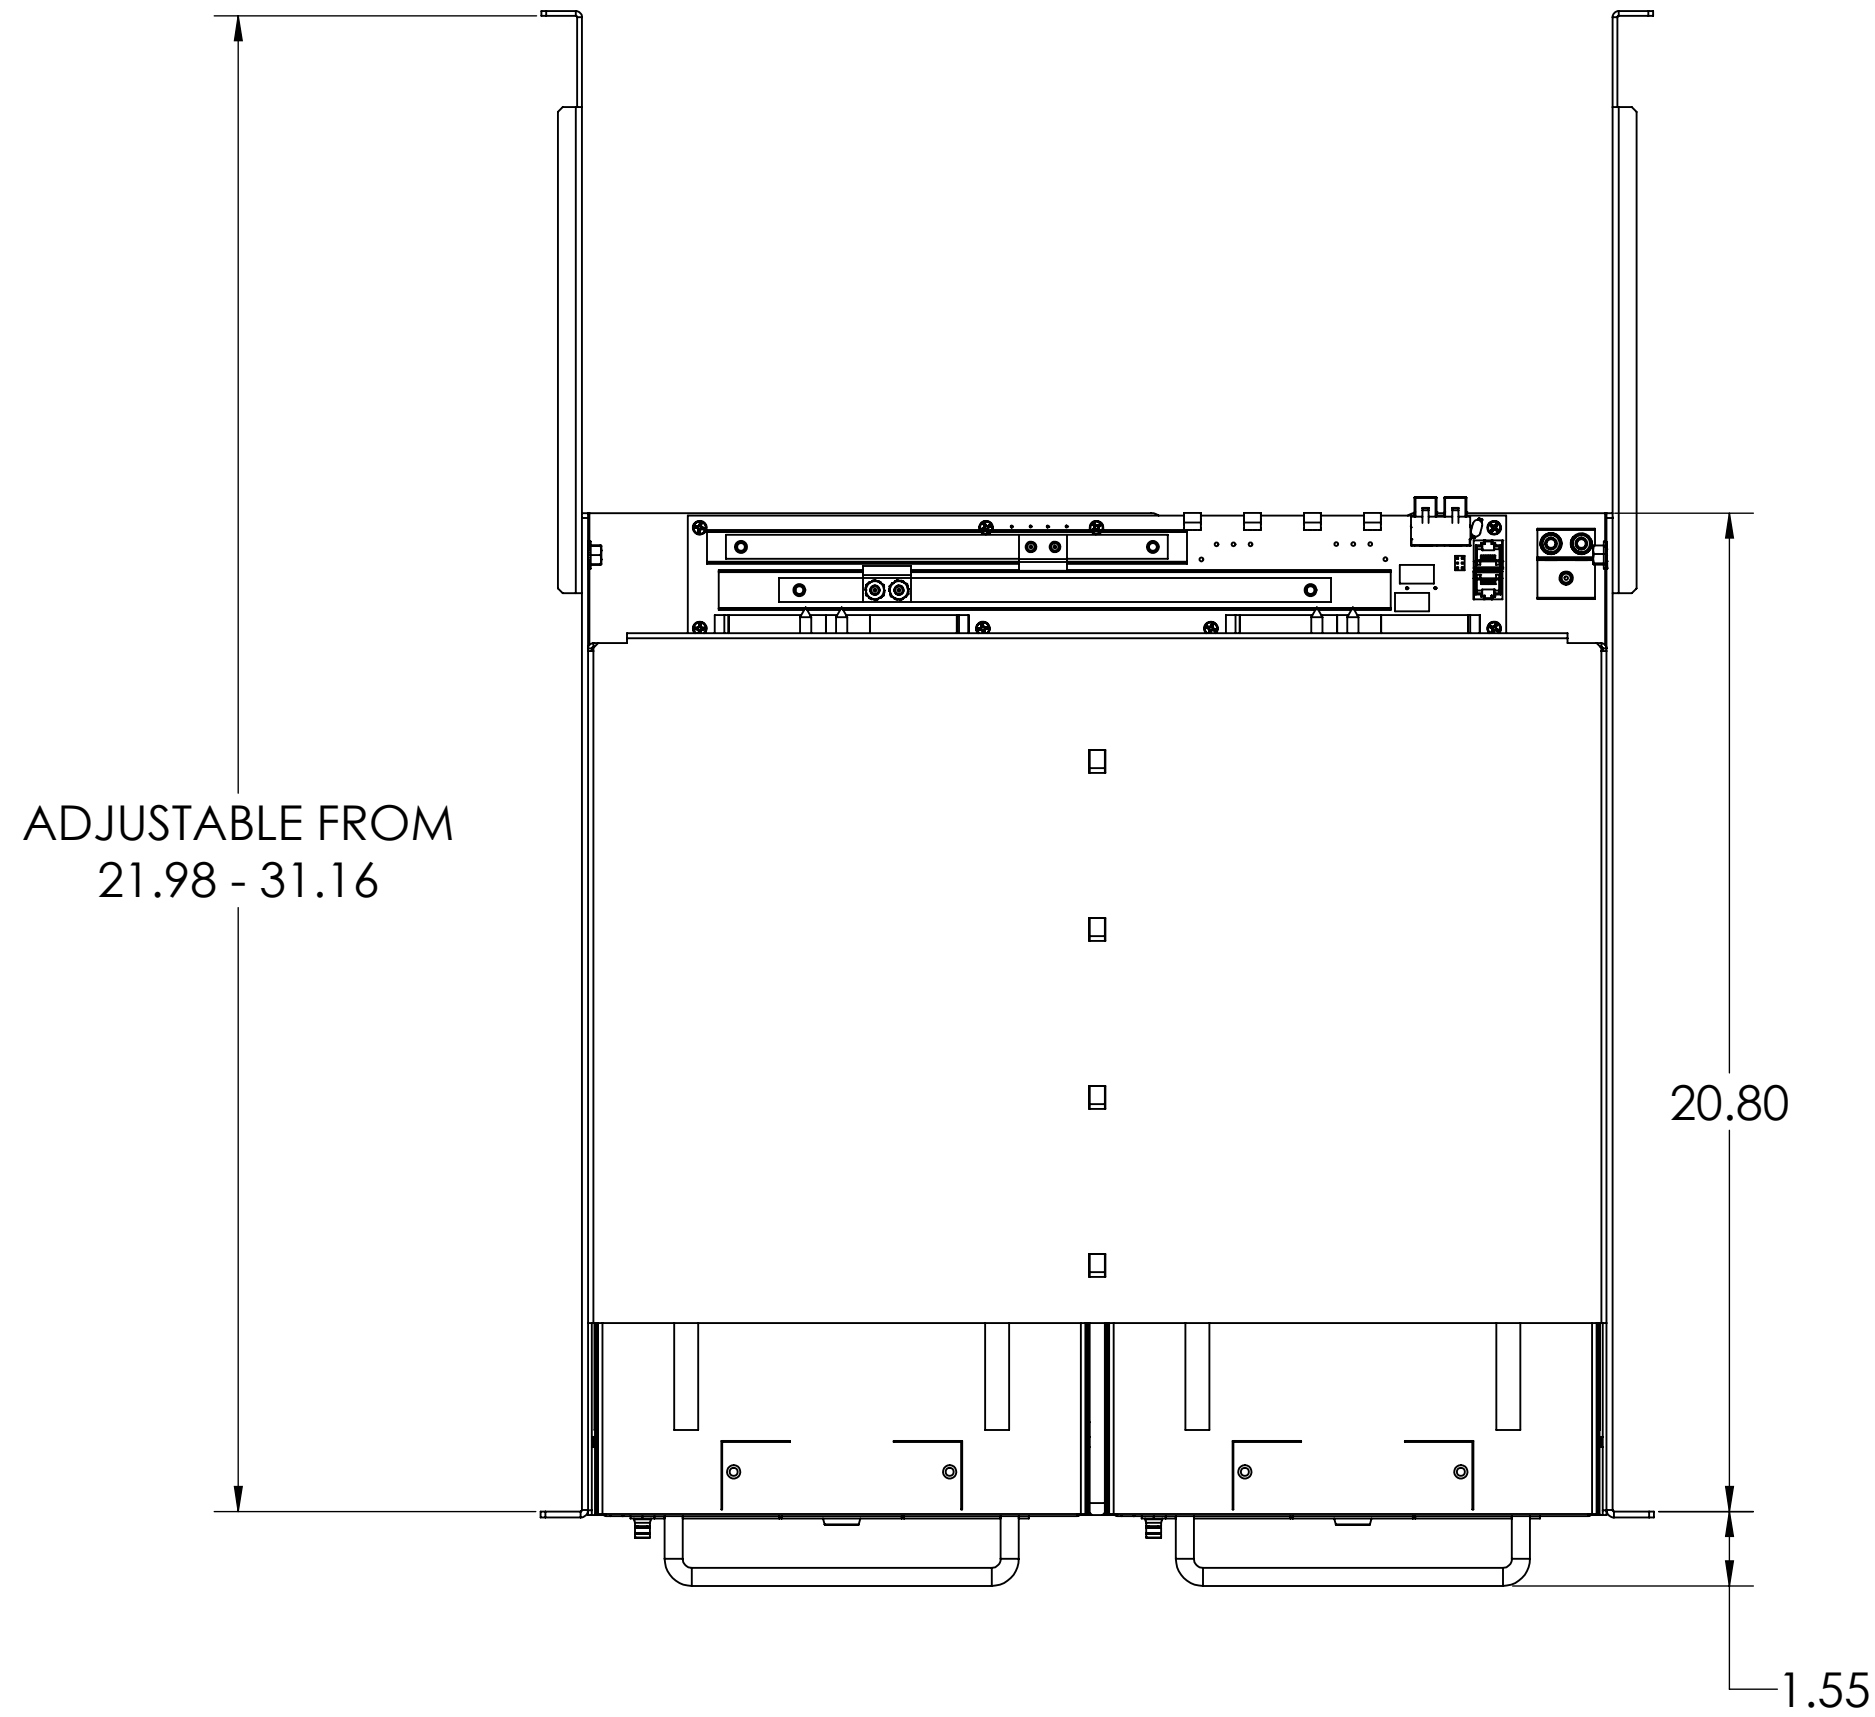

SENS
STORED ENERGY SYSTEMS
1840 INDUSTRIAL CIRCLE
LONGMONT, CO 80501
953-478-7500
WWW.SENS-USA.COM
PROPRIETARY AND CONFIDENTIAL
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE
PROPERTY OF STORED ENERGY SYSTEMS, LLC. ANY
REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN
PERMISSION OF STORED ENERGY SYSTEMS, LLC IS PROHIBITED.

UNLESS OTHERWISE SPECIFIED:
DIMENSIONS ARE IN INCHES
DEFAULT TOLERANCES:
ANGLES ± 1°
TWO PLACE DECIMAL ± .02
THREE PLACE DECIMAL ± .005
DO NOT SCALE DRAWING

NAME	DATE	DESCRIPTION	REV
DRAWN ERS	6/1/2020	2DCAD,EDC-SINGLE SHELF,STANDARD	A
CHECKED			
THIRD ANGLE PROJECTION	SIZE D	DOCUMENT NUMBER 2DCAD-EDC-SINGLE_SHELF-STD	SHEET 1 OF 1
DIMENSIONS & TOLERANCES PER ASME Y14.5 - 2009			