
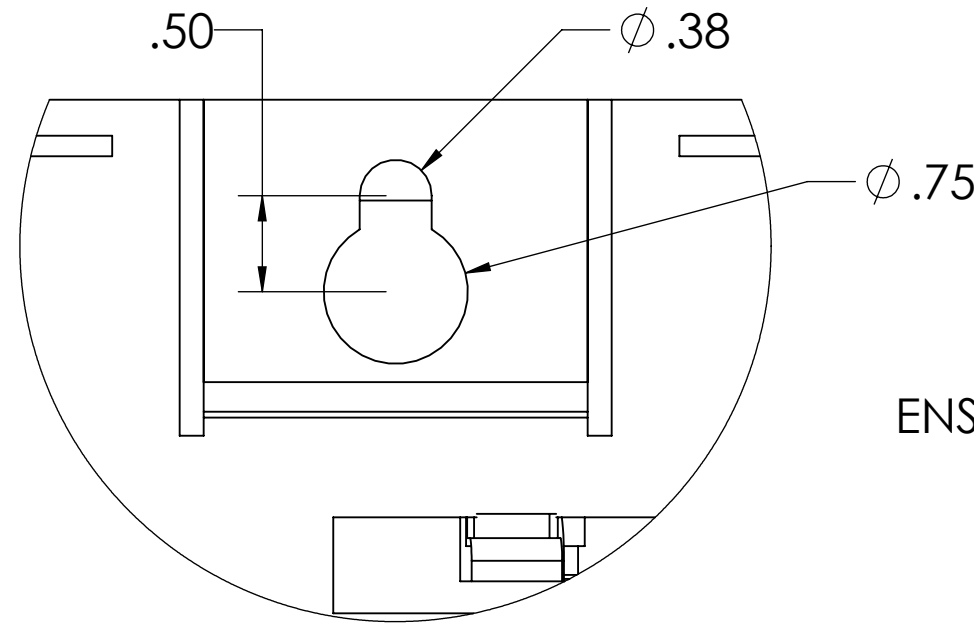







- NOTES:
1. THIS DRAWING IS FOR REFERENCE ONLY.
 2. THE INSTALLATION OF THIS EQUIPMENT SHALL COMPLY WITH ALL LOCAL AUTHORITY AND APPLICABLE BUILDING CODES.
 3. CLEARANCES - FOR VENTILATION AND SERVICABILITY PROVIDE A MINIMUM CLEARANCE OF:
 - 17.5 INCHES ON TOP OF THE UNIT.
 - 6 INCHES ON EACH SIDE OF THE UNIT.
 4. WEIGHT: 85 LBS MAXIMUM
 5. POWER MODULES MAY BE REMOVED FROM UNIT PRIOR TO INSTALLATION FOR EASE OF ASSEMBLY.
 6. ***IMPORTANT*** - WHEN INSTALLTING UNIT, ENSURE THAT NO DEBRIS OR PARTICLES FALL INTO UNIT.

REVISIONS				
DCN	REV	DESCRIPTION	DATE	APPROVED
107872	A	INITIAL RELEASE	6/1/2020	ERS



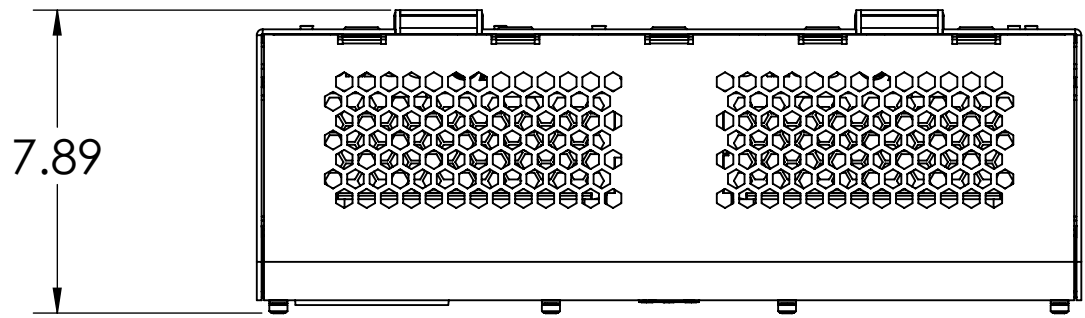


DETAIL A
SCALE 1 : 1
2 LOCATIONS

REMOVE TOP COVER TO ACCESS UPPER MOUNTING POINTS
ENSURE NO DEBRIS OR PARTICLES FALL INTO UNIT DURING INSTALLATION

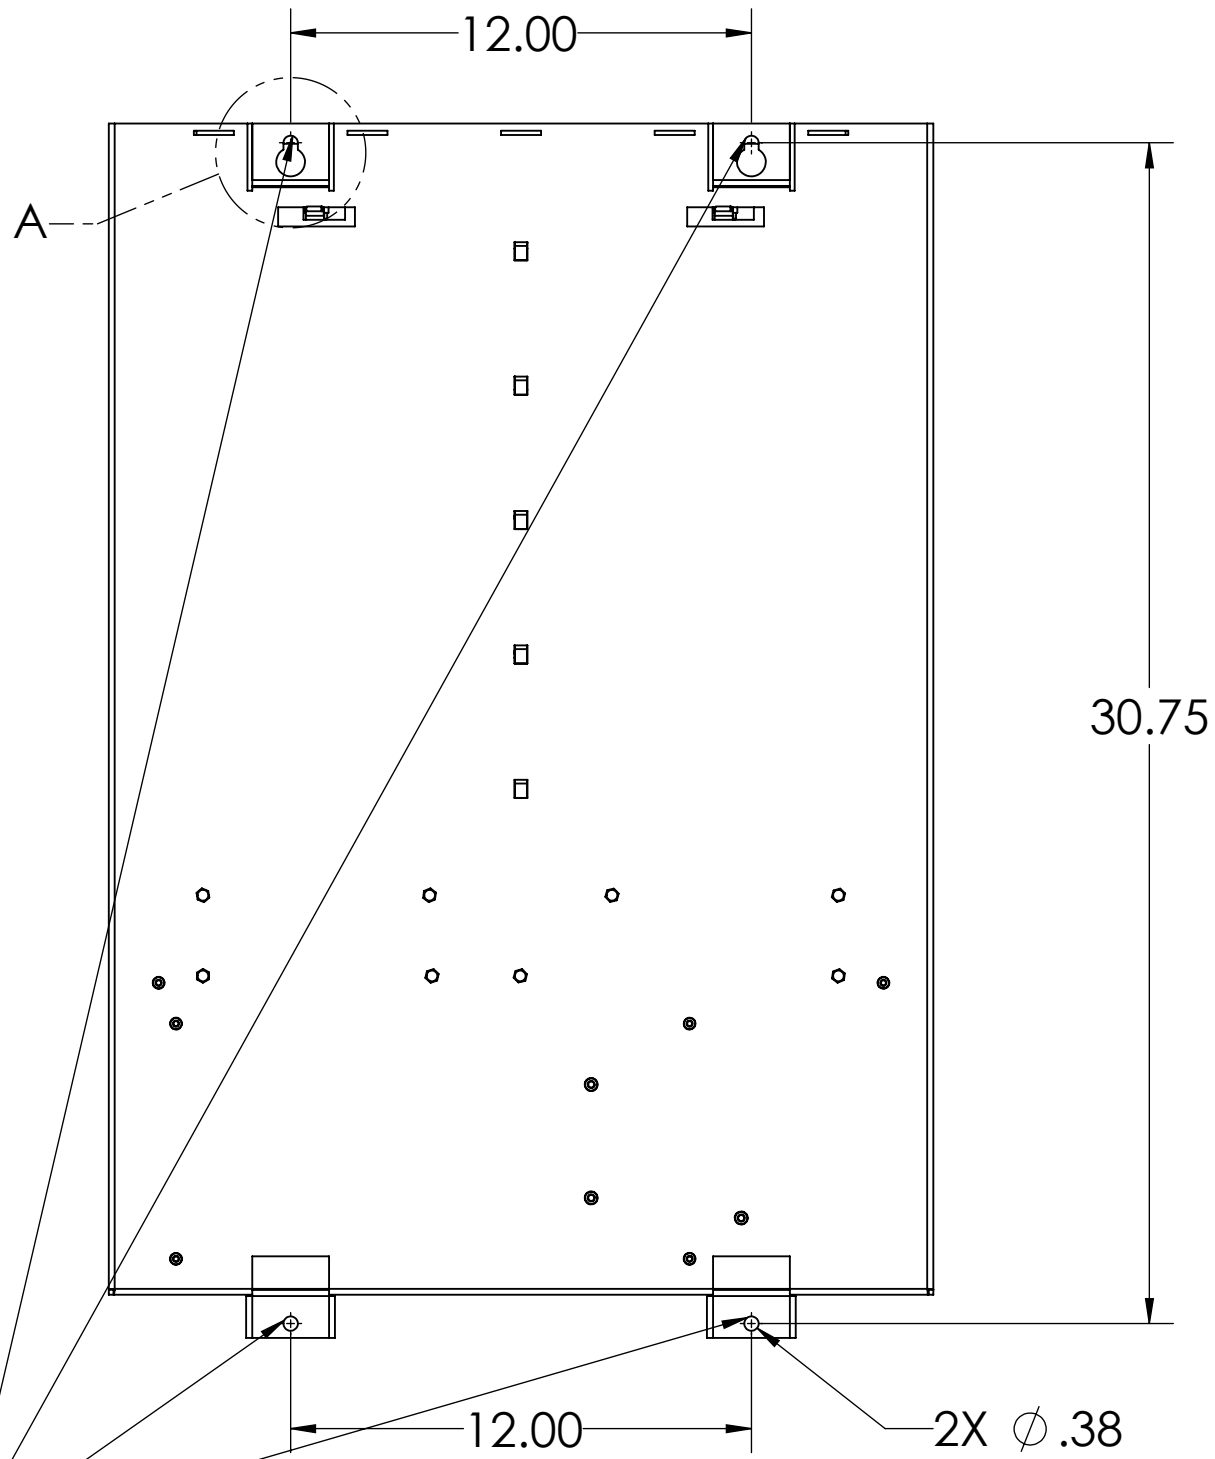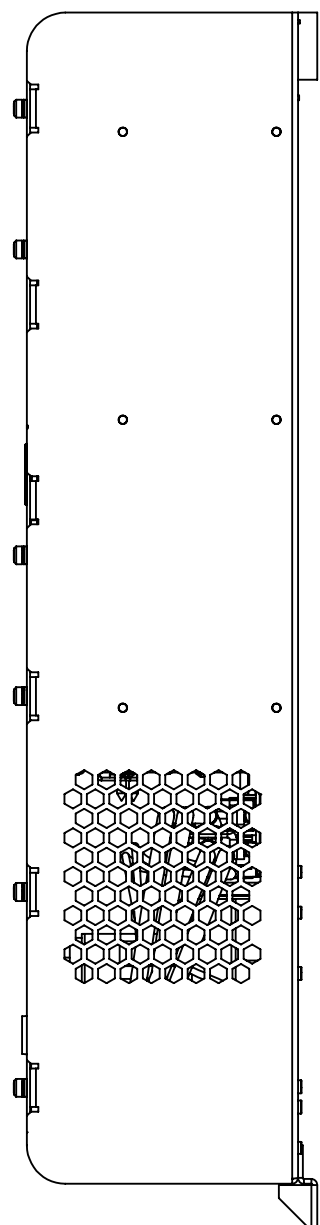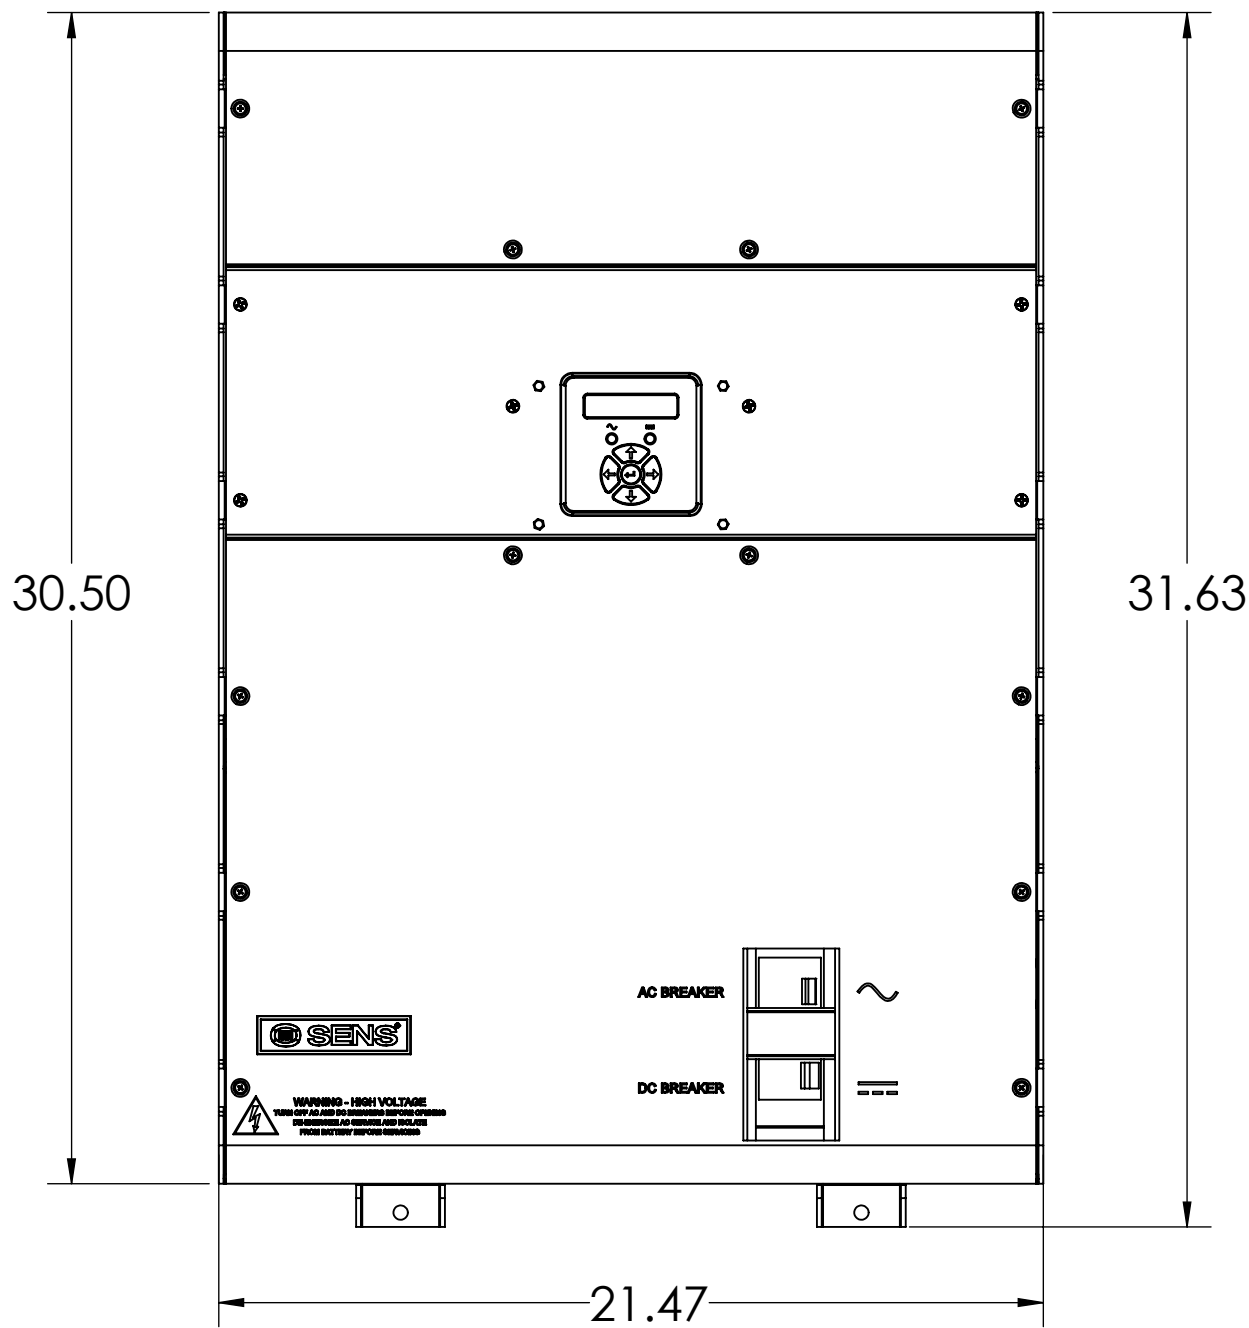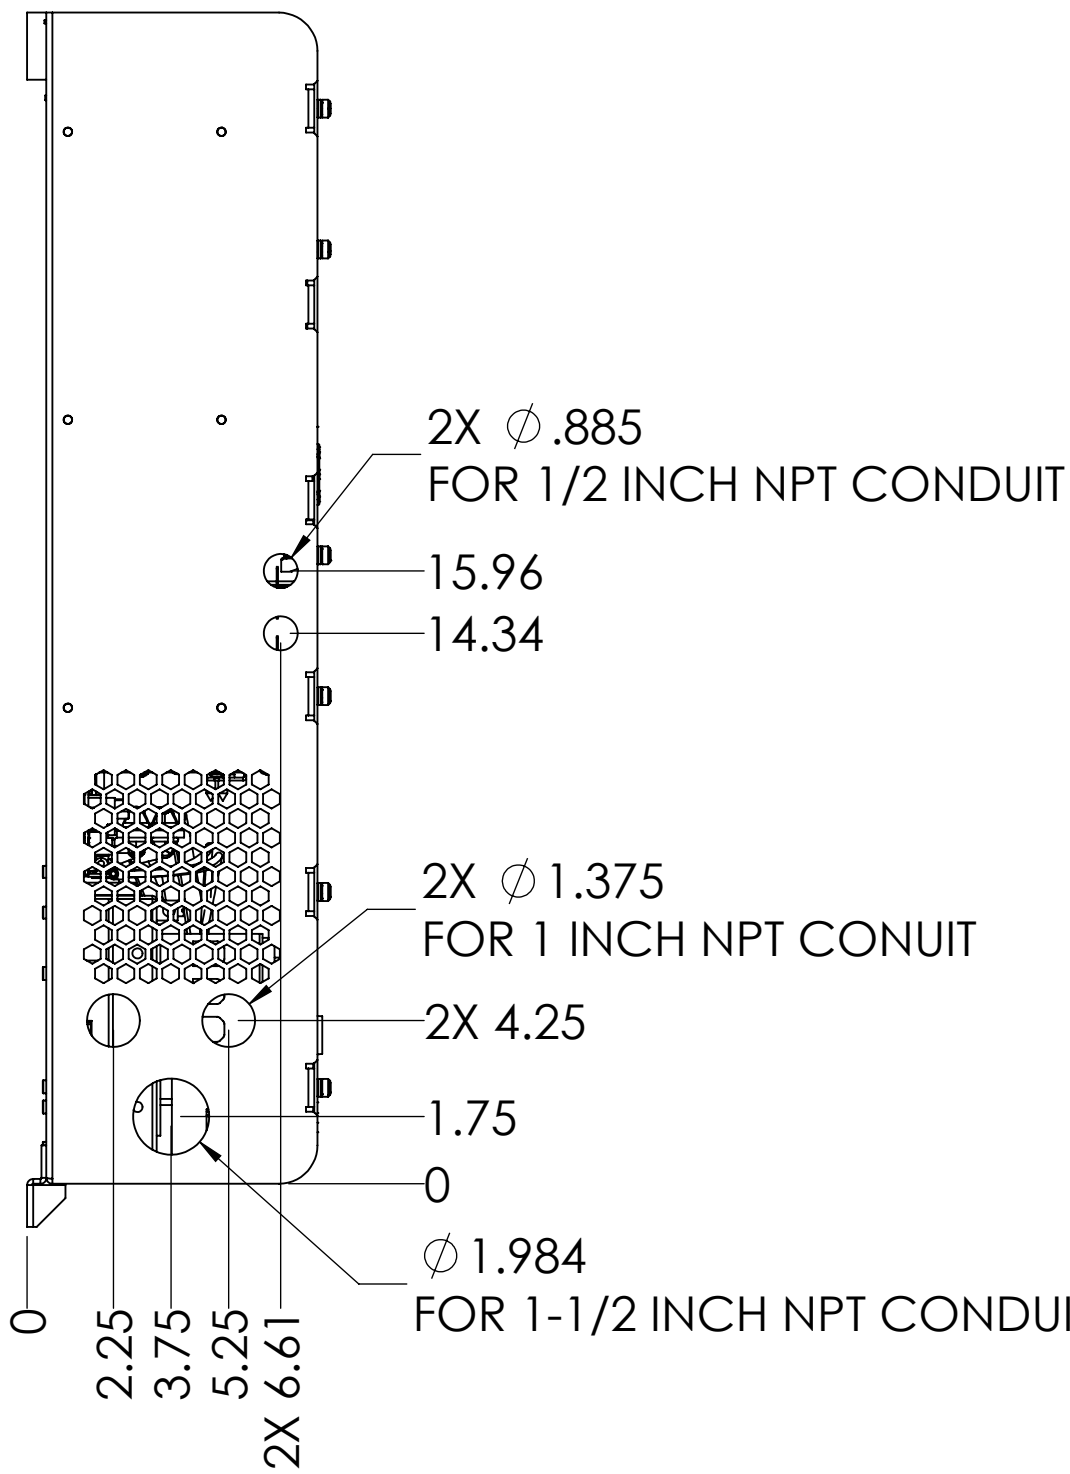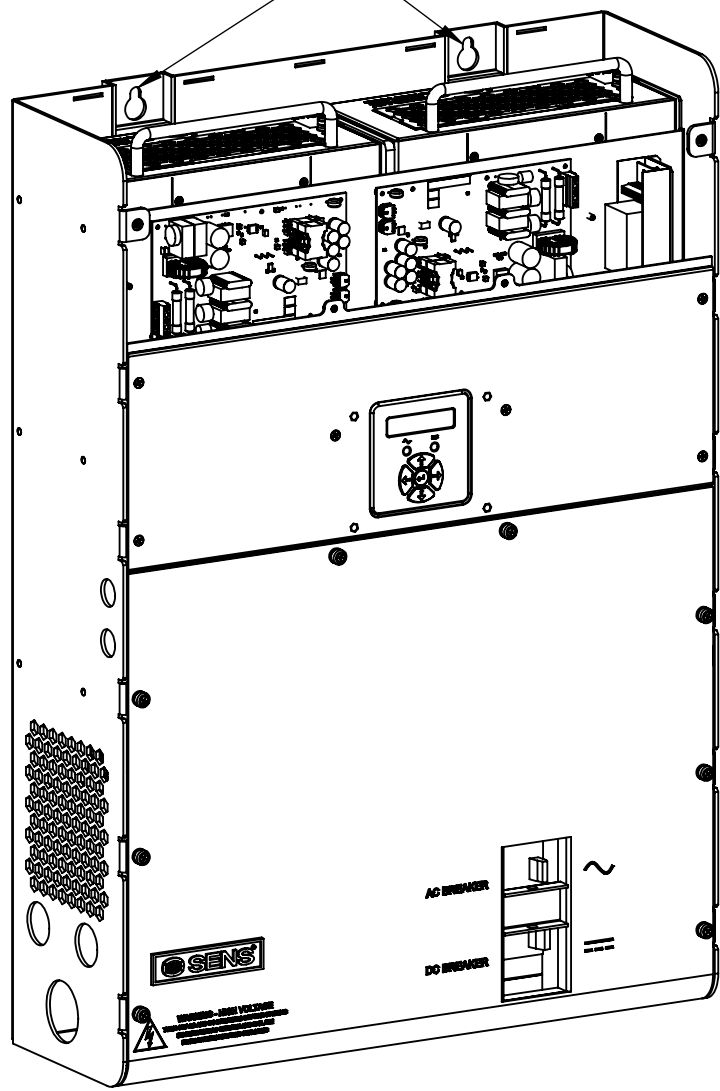

4X MOUNTING LOCATIONS
FOR 3/8IN HARDWARE

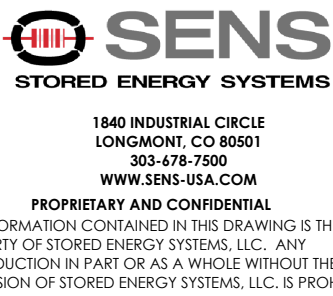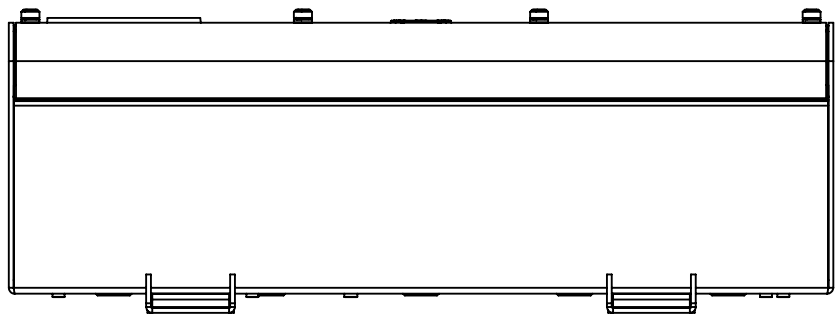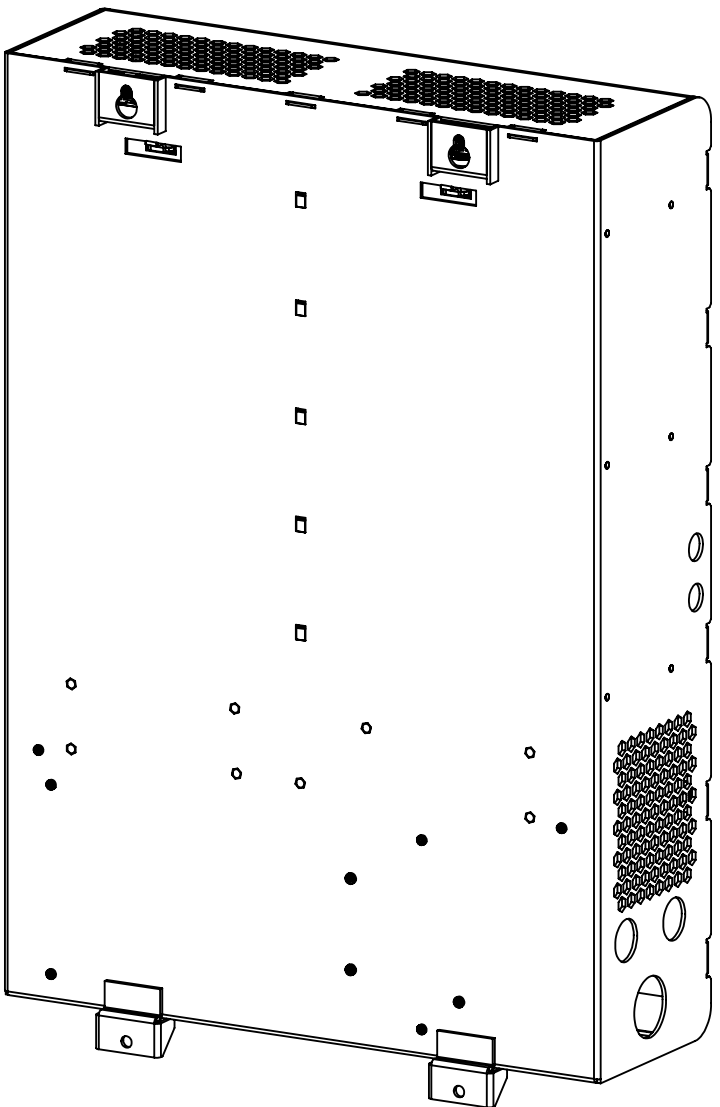

UNLESS OTHERWISE SPECIFIED:
DIMENSIONS ARE IN INCHES
DEFAULT TOLERANCES:
ANGLES ± 1°
TWO PLACE DECIMAL ± .02
THREE PLACE DECIMAL ± .005
DO NOT SCALE DRAWING

NAME	DATE
ERS	6/1/2020
CHECKED	
THIRD ANGLE PROJECTION	
DIMENSIONS & TOLERANCES PER ASME Y14.5 - 2009	

DESCRIPTION		
2DCAD,EDC-WALLBOX,STANDARD		
SIZE	DOCUMENT NUMBER	REV
D	2DCAD-EDC-WALLBOX-STD	A
		SHEET 1 OF 1