
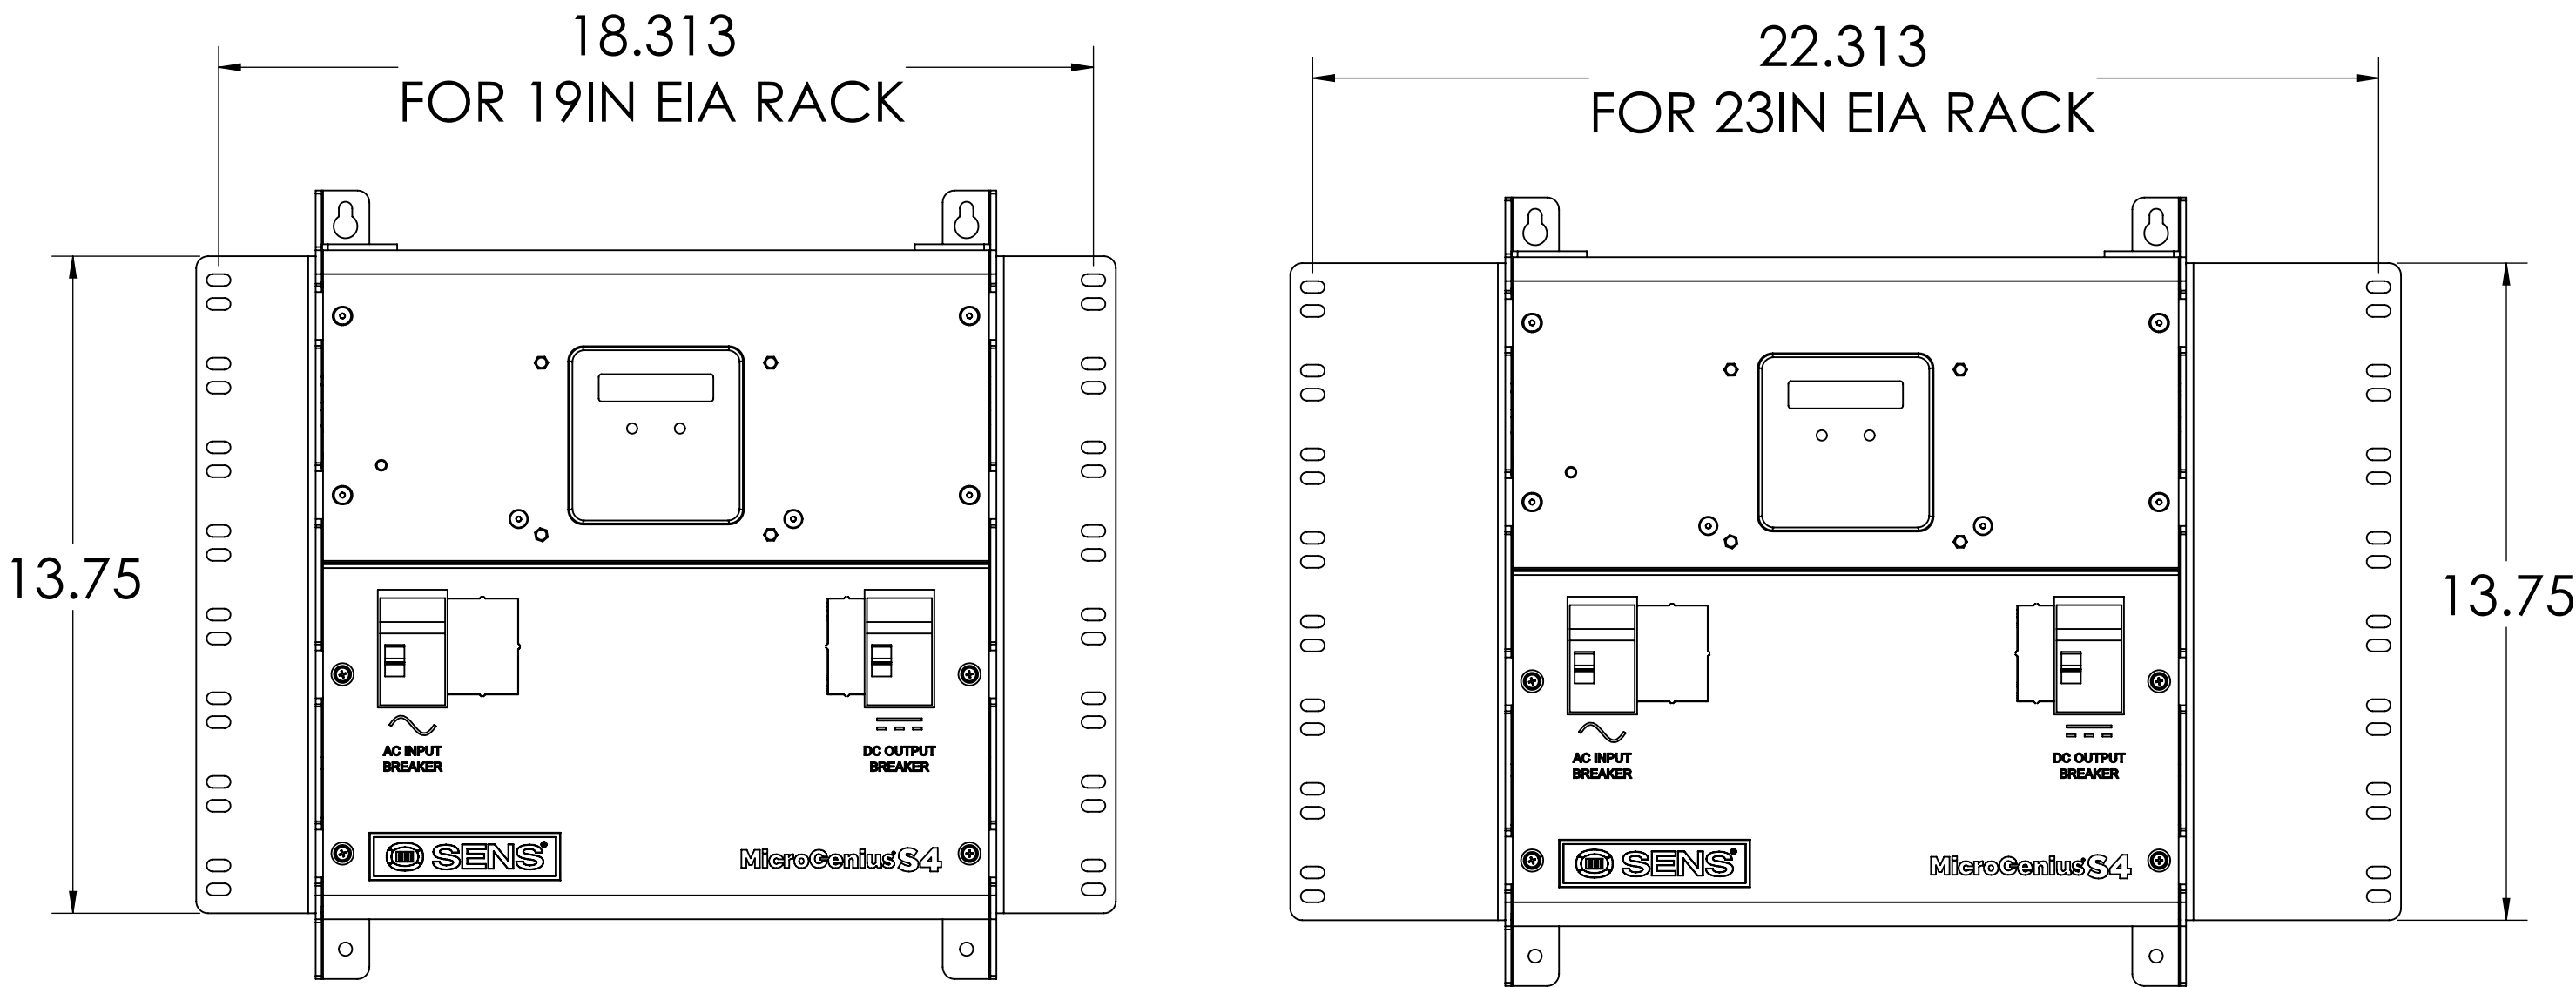
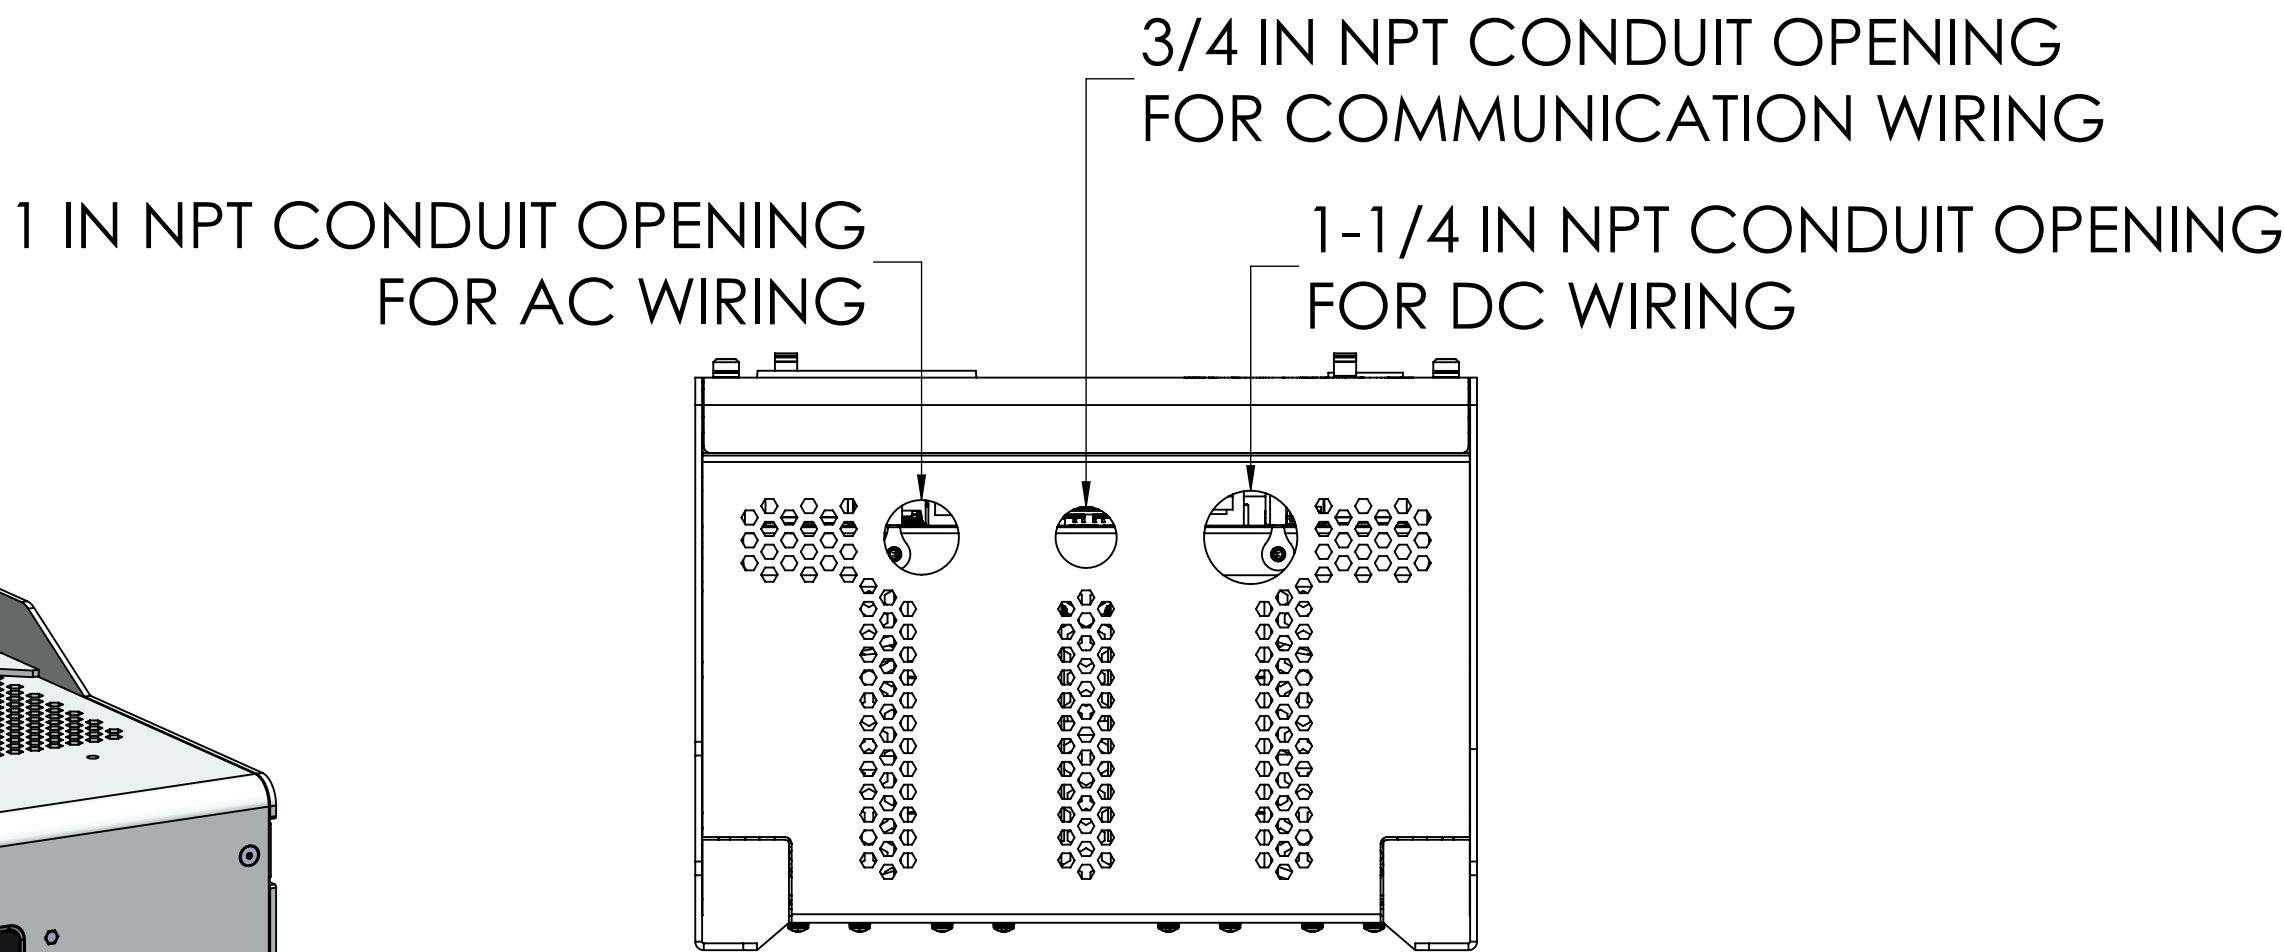
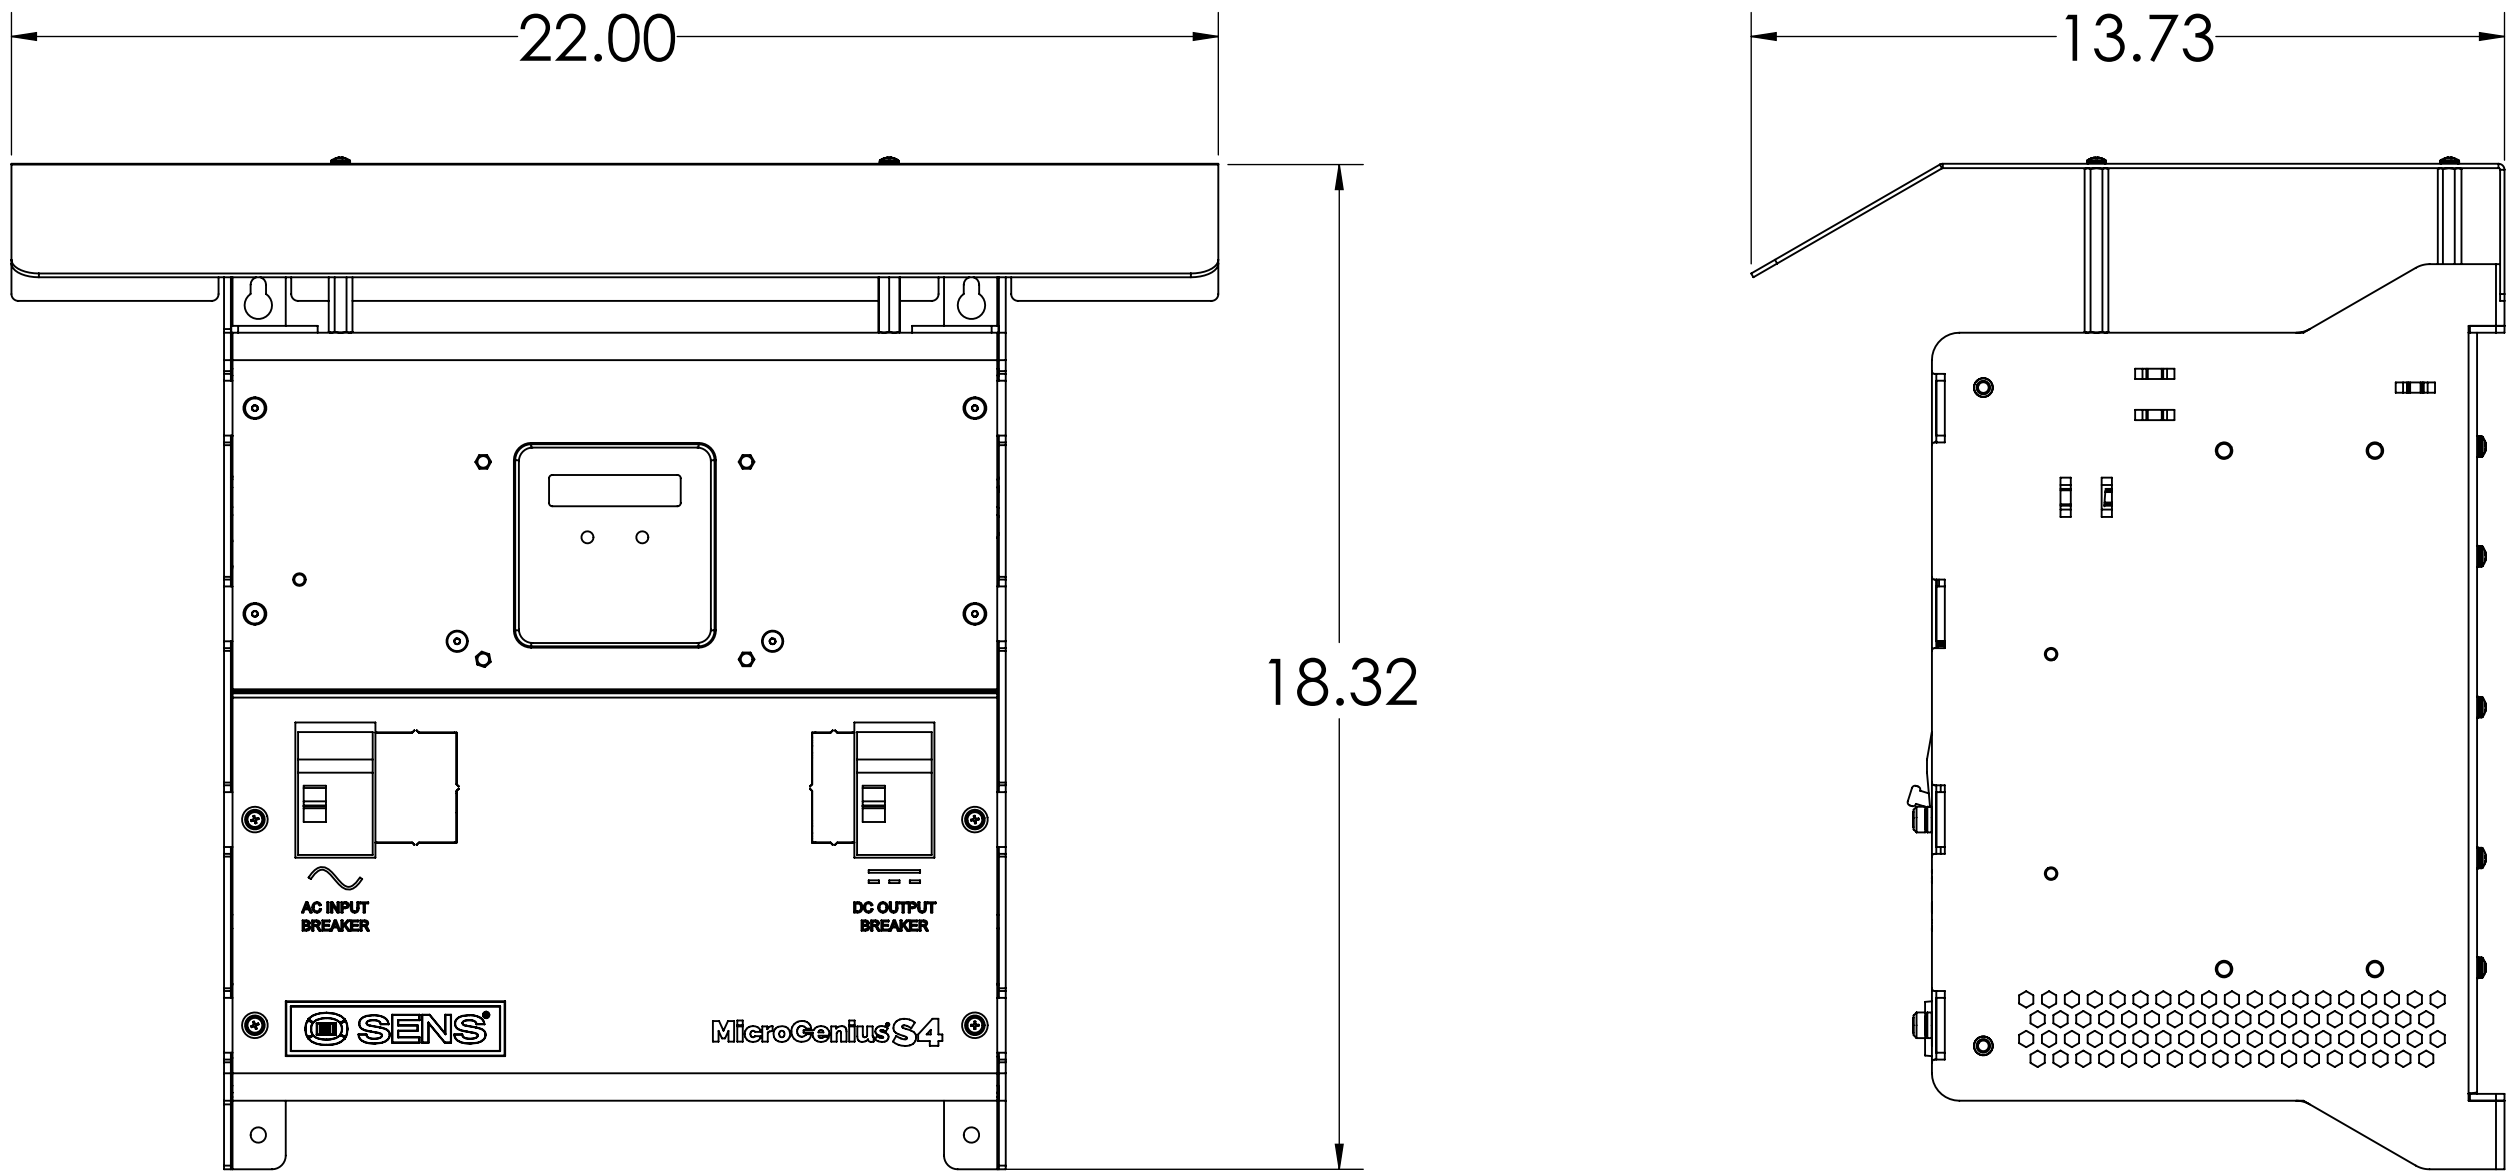


- NOTES:
- 1. DRIPSHIELD IS OPTIONAL
  - 2. 19IN AND 23IN RACKMOUNT BRACKETS ARE OPTIONAL
  - 3. THE INSTALLATION OF THIS EQUIPMENT SHALL COMPLY WITH ALL LOCAL AUTHORITY AND APPLICABLE BUILDING CODES
  - 4. PROVIDE A MINIMUM CLEARANCE (FROM CHARGER CHASSIS) OF 6.0IN ON TOP, 4.0IN ON BOTTOM, AND 0.5IN ON SIDES OF UNIT FOR VENTILATION

REVISIONS				
DCN	REV	DESCRIPTION	DATE	APPROVED
107342	A	INITIAL RELEASE	9/8/2017	ERS

THESE VIEWS SHOWN WITH OPTIONAL DRIP SHIELD

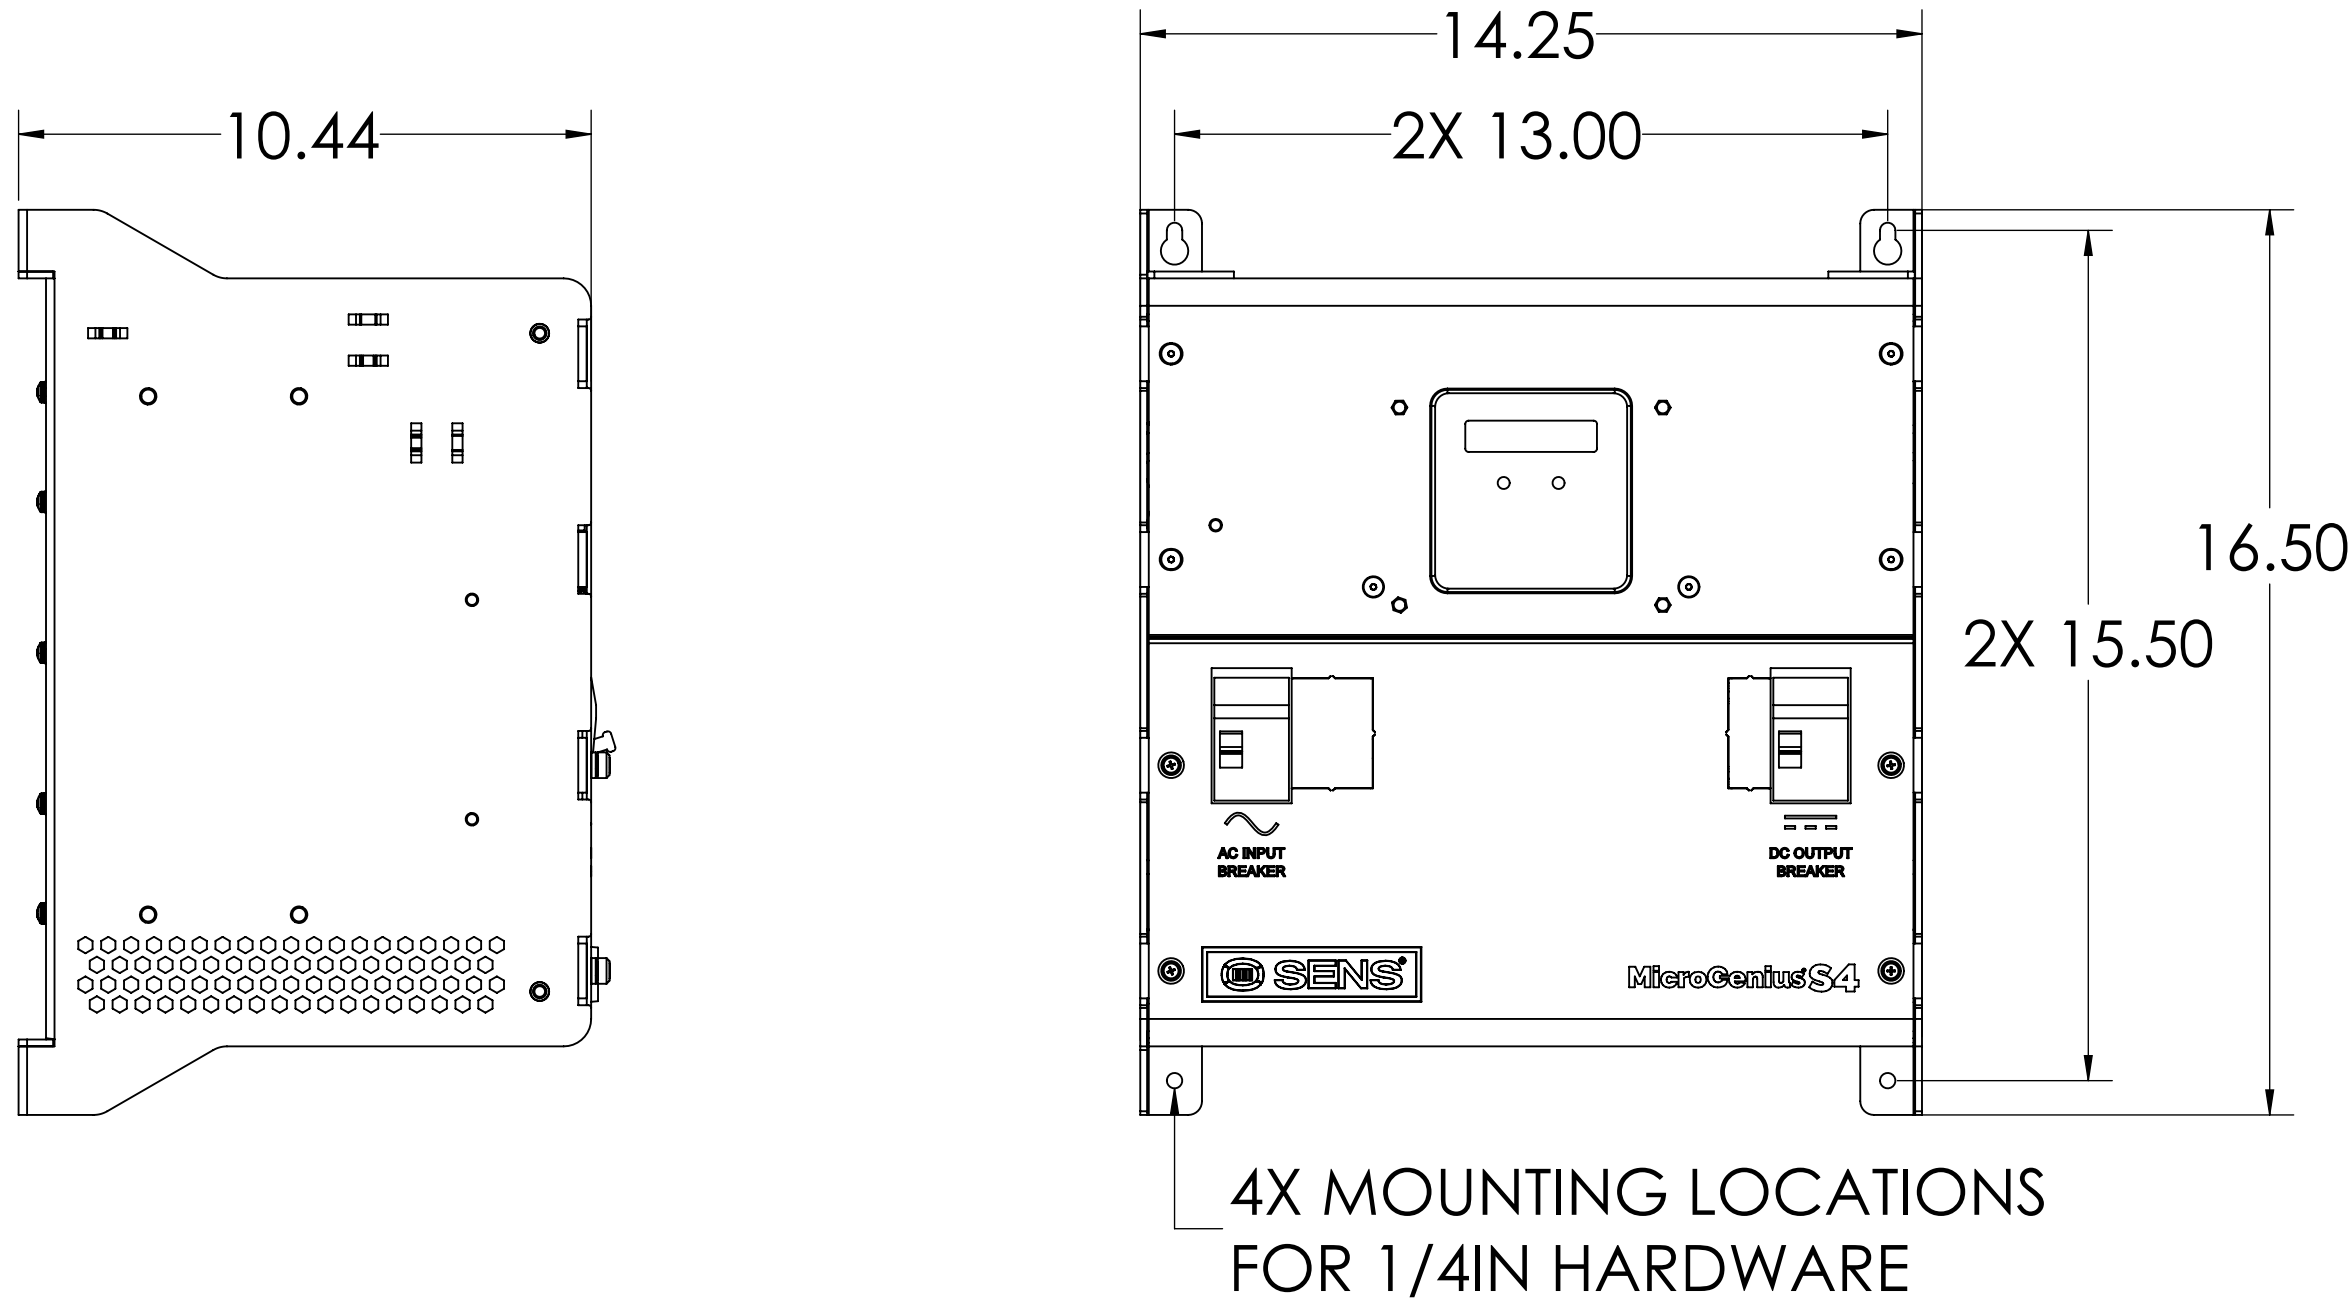

19IN RACKMOUNT BRACKETS

23IN RACKMOUNT BRACKETS



**SENS**  
STORED ENERGY SYSTEMS  
1840 INDUSTRIAL CIRCLE  
LONGMONT, CO 80501  
303-478-7500  
WWW.SENS-USA.COM  
PROPRIETARY AND CONFIDENTIAL  
THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE  
PROPERTY OF STORED ENERGY SYSTEMS, LLC. ANY  
REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN  
PERMISSION OF STORED ENERGY SYSTEMS, LLC IS PROHIBITED.

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES DEFAULT TOLERANCES: ANGLES ± 1° TWO PLACE DECIMAL ± .02 THREE PLACE DECIMAL ± .005 DO NOT SCALE DRAWING	NAME	DATE	DESCRIPTION		REV
DRAWN	ERS	9/8/2017	2DCAD,S4,STANDARD		A
CHECKED			THIRD ANGLE PROJECTION		
DIMENSIONS & TOLERANCES PER ASME Y14.5 - 2009			SIZE <b>D</b>	DOCUMENT NUMBER <b>2DCAD-S4-STD</b>	SHEET 1 OF 1